



Air Conditioning & Heating

DSXC16

COOLING CAPACITY :
24,000 - 60,000 BTU/H

HIGH-EFFICIENCY **SPLIT SYSTEM AIR CONDITIONER** **UP TO 16 SEER**



Contents

Nomenclature	2
Product Specifications.....	3
Expanded Cooling Data.....	4
AHRI Ratings.....	20
Wiring Diagram	27
Dimensions.....	28
Accessories.....	28

Standard Features


- Two-Stage Copeland® UltraTech™ scroll compressor
- High-density foam compressor sound blanket
- ComfortNet™ Communications System compatible
- Expanded ComfortAlert™ diagnostics
- Set-up capable with two low-voltage wires to outdoor unit
- Diagnostic indicator lights and storage of 6 fault codes
- Color-coded terminal strip for non-communicating set-up
- High- and low-pressure switches
- Factory-installed filter drier
- Coil and ambient temperature sensors
- Two-speed, quiet condenser fan motor
- AHRI Certified; ETL Listed

Cabinet Features

- Heavy-gauge galvanized-steel cabinet with sound control top
- Baked-on powder paint finish
- Wire fan discharge grille
- Steel louver coil guard
- Top and side maintenance access
- Single-panel access to controls with space provided for field-installed accessories
- When properly anchored, meets 2010 Florida Building Code unit integrity requirements for hurricane-type winds (Anchor bracket kits available.)



* Complete warranty details available from your local dealer or at www.goodmanmfg.com. To receive the Lifetime Compressor Limited Warranty (good for as long as you own your home), 10-Year Unit Replacement Limited Warranty and 10-Year Parts Limited Warranty, online registration must be completed within 60 days of installation. Online registration is not required in California or Québec.

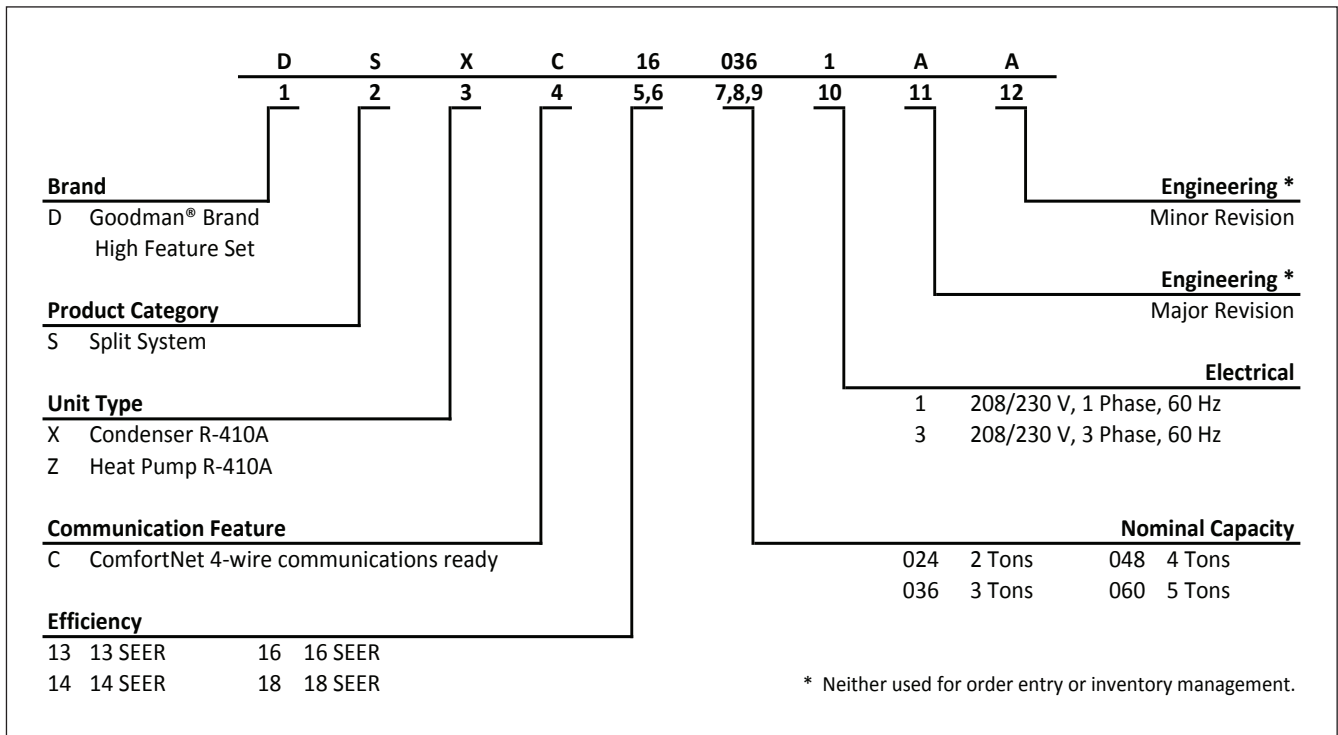

	DSXC16 0241AA/B	DSXC16 0241AC	DSXC16 0361AA/B	DSXC16 0361AC	DSXC16 0481B*	DSXC16 0601B*
COOLING CAPACITY						
Nominal Cooling (BTU/h)	24,000	24,000	36,000	36,000	48,000	60,000
Decibels	71	71	70.4/70.9	70.4/70.9	74	75
COMPRESSOR						
RLA	10.3	11.7	16.7	15.3	21.2	28.8
LRA	52.0	58.0	82.0	83.0	104.0	152.9
CONDENSER FAN MOTOR						
Horsepower (RPM)	1/6	1/6	1/6	1/6	1/6	1/6
FLA	1.1	1.1	0.9	0.9	1.2	1.0
REFRIGERATION SYSTEM						
Refrigerant Line Size ¹						
Liquid Line Size ("O.D.)	3/8"	3/8"	3/8"	3/8"	3/8"	3/8"
Suction Line Size ("O.D.)	3/4"	3/4"	7/8"	7/8"	1 1/8"	1 1/8"
Refrigerant Connection Size						
Liquid Valve Size ("O.D.)	3/8"	3/8"	3/8"	3/8"	3/8"	3/8"
Suction Valve Size ("O.D.)	3/4"	3/4"	3/4"	3/4"	7/8"	7/8"
Valve Connection Type	Sweat	Sweat	Sweat	Sweat	Sweat	Sweat
Refrigerant Charge	97	97	107	107	132	197
ELECTRICAL DATA						
Voltage-Hz	208/230-60	208/230-60	208/230-60	208/230-60	208/230-60	208/230-60
Minimum Circuit Ampacity ²	14.0	15.7	21.8	20.0	27.7	37.2
Max. Overcurrent Protection ³	20	20	35	35	45	60
Min / Max Volts	197/253	197/253	197/253	197/253	197/253	197/253
Power Supply	1/2" or 3/4"	1/2" or 3/4"	1/2" or 3/4"	1/2" or 3/4"	1/2" or 3/4"	1/2" or 3/4"
EQUIPMENT WEIGHT (LBS)						
	181	181	184	184	219	279
SHIP WEIGHT (LBS)						
	198	198	202	202	241	301

¹ Tested and rated in accordance with ARI Standard 210/240

² Wire size should be determined in accordance with National Electrical Codes; extensive wire runs will require larger wire sizes

³ Must use time-delay fuses or HACR-type circuit breakers of the same size as noted.

NOTES

- Always check the S&R plate for electrical data on the unit being installed.
- Installer will need to supply 7/8" to 1 1/8" adapters for suction line connections.
- Unit is charged with refrigerant for 15' of 3/8" liquid line. System charge must be adjusted per Installation Instructions Final Charge Procedure.
- Installation of these units requires the specified TXV Kit to be installed on the indoor coil. THE SPECIFIED TXV IS DETERMINED BY THE OUTDOOR UNIT, NOT THE INDOOR COIL.

IDB	AIRFLOW	OUTDOOR AMBIENT TEMPERATURE												ENTERING INDOOR WET BULB TEMPERATURE											
		65°F				75°F				85°F				95°F				105°F				115°F			
		59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71
70	MBh	18.0	18.7	20.4	-	17.6	18.2	20.0	-	17.2	17.8	19.5	-	16.7	17.4	19.0	-	15.9	16.5	18.1	-	14.7	15.3	16.7	-
	S/T	0.75	0.63	0.43	-	0.78	0.65	0.45	-	0.80	0.66	0.46	-	0.82	0.69	0.48	-	0.85	0.71	0.49	-	0.86	0.72	0.50	-
	ΔT	18	16	12	-	19	16	12	-	19	16	12	-	19	16	12	-	18	16	12	-	17	15	11	-
	KW	1.10	1.12	1.16	-	1.19	1.21	1.25	-	1.26	1.29	1.34	-	1.33	1.37	1.41	-	1.39	1.43	1.48	-	1.44	1.48	1.53	-
	Amps	4.5	4.6	4.7	-	4.8	4.9	5.1	-	5.2	5.3	5.5	-	5.6	5.7	5.9	-	5.9	6.1	6.3	-	6.3	6.4	6.6	-
	HI PR	228	245	248	-	258	277	281	-	293	315	319	-	334	359	364	-	375	404	409	-	420	452	458	-
	Lo PR	122	125	137	-	125	129	141	-	129	133	146	-	133	137	150	-	135	140	153	-	139	143	156	-
	MBh	17.5	18.1	19.8	-	17.1	17.7	19.4	-	16.7	17.3	18.9	-	16.3	16.8	18.5	-	15.4	16.0	17.5	-	14.3	14.8	16.2	-
	S/T	0.71	0.60	0.41	-	0.74	0.62	0.43	-	0.76	0.63	0.44	-	0.78	0.65	0.45	-	0.81	0.68	0.47	-	0.82	0.68	0.47	-
	ΔT	19	17	13	-	19	17	13	-	19	17	13	-	20	17	13	-	19	17	13	-	18	16	12	-
	KW	1.09	1.11	1.15	-	1.18	1.20	1.24	-	1.25	1.28	1.33	-	1.32	1.35	1.40	-	1.38	1.41	1.46	-	1.43	1.47	1.52	-
	Amps	4.4	4.5	4.7	-	4.8	4.9	5.0	-	5.2	5.3	5.5	-	5.5	5.7	5.8	-	5.9	6.0	6.2	-	6.2	6.4	6.6	-
HI PR	226	243	246	-	255	274	278	-	290	312	316	-	330	355	360	-	372	400	405	-	416	447	454	-	
Lo PR	120	124	136	-	124	128	140	-	128	132	144	-	132	136	148	-	134	138	151	-	137	142	155	-	
MBh	16.1	16.7	18.3	-	15.8	16.3	17.9	-	15.4	15.9	17.5	-	15.0	15.6	17.0	-	14.3	14.8	16.2	-	13.2	13.7	15.0	-	
S/T	0.69	0.58	0.40	-	0.71	0.60	0.41	-	0.73	0.61	0.42	-	0.76	0.63	0.44	-	0.78	0.65	0.45	-	0.79	0.66	0.46	-	
ΔT	19	17	13	-	20	17	13	-	20	17	13	-	20	17	13	-	20	17	13	-	18	16	12	-	
KW	1.08	1.10	1.14	-	1.17	1.19	1.23	-	1.24	1.27	1.31	-	1.31	1.34	1.39	-	1.37	1.40	1.45	-	1.42	1.45	1.50	-	
Amps	4.4	4.5	4.6	-	4.7	4.8	5.0	-	5.1	5.3	5.4	-	5.5	5.6	5.8	-	5.8	6.0	6.2	-	6.2	6.3	6.5	-	
HI PR	223	240	244	-	252	271	275	-	287	309	313	-	327	352	357	-	368	396	401	-	412	443	449	-	
Lo PR	119	123	134	-	123	127	138	-	127	131	143	-	130	134	147	-	133	137	150	-	136	140	153	-	

75	MBh	18.3	18.8	20.4	21.9	17.9	18.4	19.9	21.4	17.5	18.0	19.4	20.9	17.0	17.5	19.0	20.4	16.2	16.7	18.0	19.3	15.0	15.4	16.7	17.9
	S/T	0.85	0.76	0.58	0.37	0.88	0.79	0.60	0.38	0.90	0.81	0.61	0.39	0.93	0.84	0.63	0.41	0.97	0.87	0.66	0.42	0.98	0.87	0.66	0.43
	ΔT	21	20	16	11	21	20	16	11	22	20	16	11	22	20	16	11	21	20	16	11	20	18	15	10
	KW	1.10	1.12	1.16	1.20	1.19	1.21	1.25	1.30	1.26	1.29	1.34	1.38	1.33	1.37	1.41	1.46	1.39	1.43	1.48	1.53	1.44	1.48	1.53	1.58
	Amps	4.5	4.6	4.7	4.9	4.8	4.9	5.1	5.3	5.2	5.3	5.5	5.7	5.6	5.7	5.9	6.1	5.9	6.1	6.3	6.5	6.3	6.4	6.6	6.9
	HI PR	228	245	248	254	258	277	281	287	293	315	319	326	334	359	364	372	375	404	409	418	420	452	458	468
	Lo PR	122	125	137	146	125	129	141	150	129	133	146	155	133	137	150	159	135	140	153	162	139	143	156	166
	MBh	17.8	18.3	19.8	21.3	17.4	17.9	19.3	20.8	16.9	17.4	18.9	20.3	16.5	17.0	18.4	19.8	15.7	16.2	17.5	18.8	14.5	15.0	16.2	17.4
	S/T	0.81	0.73	0.55	0.35	0.84	0.75	0.57	0.37	0.86	0.77	0.58	0.38	0.89	0.80	0.60	0.39	0.92	0.83	0.63	0.40	0.93	0.83	0.63	0.41
	ΔT	22	20	17	12	22	21	17	12	22	21	17	12	22	21	17	12	22	20	17	12	21	19	16	11
	KW	1.09	1.11	1.15	1.19	1.18	1.20	1.24	1.29	1.25	1.28	1.33	1.37	1.32	1.35	1.40	1.45	1.38	1.41	1.46	1.51	1.43	1.47	1.52	1.57
	Amps	4.4	4.5	4.7	4.8	4.8	4.9	5.0	5.2	5.2	5.3	5.5	5.7	5.5	5.7	5.8	6.1	5.9	6.0	6.2	6.4	6.2	6.4	6.6	6.8
HI PR	226	243	246	251	255	274	278	284	290	312	316	323	330	355	360	368	372	400	405	414	416	447	454	464	
Lo PR	120	124	136	144	124	128	140	149	128	132	144	154	132	136	148	158	134	138	151	161	137	142	155	165	
MBh	16.4	16.9	18.3	19.6	16.0	16.5	17.9	19.2	15.6	16.1	17.4	18.7	15.3	15.7	17.0	18.2	14.5	14.9	16.2	17.3	13.4	13.8	15.0	16.1	
S/T	0.78	0.70	0.53	0.34	0.81	0.73	0.55	0.35	0.83	0.74	0.56	0.36	0.86	0.77	0.58	0.37	0.89	0.80	0.60	0.39	0.90	0.80	0.61	0.39	
ΔT	22	21	17	12	23	21	17	12	23	21	17	12	23	21	17	12	23	21	17	12	21	19	16	11	
KW	1.08	1.10	1.14	1.18	1.17	1.19	1.23	1.27	1.24	1.27	1.31	1.36	1.31	1.34	1.39	1.44	1.37	1.40	1.45	1.50	1.42	1.45	1.50	1.56	
Amps	4.4	4.5	4.6	4.8	4.7	4.8	5.0	5.2	5.1	5.3	5.4	5.6	5.5	5.6	5.8	6.0	5.8	6.0	6.2	6.4	6.2	6.3	6.5	6.8	
HI PR	223	240	244	249	252	271	275	281	287	309	313	320	327	352	357	364	368	396	401	410	412	443	449	459	
Lo PR	119	123	134	143	123	127	138	147	127	131	143	152	130	134	147	156	133	137	150	159	136	140	153	163	

IDB = Entering Indoor Dry Bulb Temperature
 High and low pressures are measured at the liquid and suction service valves.
 Shaded area reflects ACCA (TVA) conditions
 kW = Total system power
 Amps = outdoor unit amps (comp.+fan)

IDB	AIRFLOW	OUTDOOR AMBIENT TEMPERATURE												ENTERING INDOOR WET BULB TEMPERATURE											
		65°F				75°F				85°F				95°F				105°F				115°F			
		59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71
80	MBh	18.6	19.0	20.3	21.7	18.2	18.6	19.9	21.2	17.8	18.1	19.4	20.7	17.3	17.7	18.9	20.2	16.5	16.8	18.0	19.2	15.2	15.6	16.6	17.8
	S/T	0.93	0.88	0.71	0.53	0.97	0.91	0.74	0.55	1.00	0.93	0.76	0.57	1.00	0.96	0.78	0.58	1.00	1.00	0.81	0.61	1.00	1.00	0.82	0.61
	ΔT	24	23	20	16	24	23	20	16	24	23	20	16	24	23	20	16	24	23	20	16	21	21	19	15
	kW	1.10	1.12	1.16	1.20	1.19	1.21	1.25	1.30	1.26	1.29	1.34	1.38	1.33	1.37	1.41	1.46	1.39	1.43	1.48	1.53	1.44	1.48	1.53	1.58
	Amps	4.5	4.6	4.7	4.9	4.8	4.9	5.1	5.3	5.2	5.3	5.5	5.7	5.6	5.7	5.9	6.1	5.9	6.1	6.3	6.5	6.3	6.4	6.6	6.9
	HI PR	228	245	248	254	258	277	281	287	293	315	319	326	334	359	364	372	375	404	409	418	420	452	458	468
	Lo PR	122	125	137	146	125	129	141	150	129	133	146	155	133	137	150	159	135	140	153	162	139	143	156	166
	MBh	18.1	18.5	19.7	21.1	17.7	18.1	19.3	20.6	17.2	17.6	18.8	20.1	16.8	17.2	18.4	19.6	16.0	16.3	17.4	18.7	14.8	15.1	16.2	17.3
	S/T	0.89	0.84	0.68	0.51	0.92	0.87	0.70	0.53	0.95	0.89	0.72	0.54	0.98	0.92	0.75	0.56	1.00	0.95	0.77	0.58	1.00	0.96	0.78	0.58
	ΔT	25	24	21	16	25	24	21	17	25	24	21	17	25	24	21	17	24	24	21	17	23	22	19	15
kW	1.09	1.11	1.15	1.19	1.18	1.20	1.24	1.29	1.25	1.28	1.33	1.37	1.32	1.35	1.40	1.45	1.38	1.41	1.46	1.51	1.43	1.47	1.52	1.57	
Amps	4.4	4.5	4.7	4.8	4.8	4.9	5.0	5.2	5.2	5.3	5.5	5.7	5.5	5.7	5.8	6.1	5.9	6.0	6.2	6.4	6.2	6.4	6.6	6.8	
HI PR	226	243	246	251	255	274	278	284	290	312	316	323	330	355	360	368	372	400	405	414	416	447	454	464	
Lo PR	120	124	136	144	124	128	140	149	128	132	144	154	132	136	148	158	134	138	151	161	137	142	155	165	
MBh	16.7	17.1	18.2	19.5	16.3	16.7	17.8	19.0	15.9	16.3	17.4	18.6	15.5	15.9	17.0	18.1	14.8	15.1	16.1	17.2	13.7	14.0	14.9	15.9	
S/T	0.86	0.81	0.66	0.49	0.89	0.83	0.68	0.51	0.91	0.86	0.70	0.52	0.94	0.88	0.72	0.54	0.98	0.92	0.75	0.56	0.99	0.92	0.75	0.56	
ΔT	25	24	21	17	25	24	21	17	25	24	21	17	26	25	21	17	25	24	21	17	24	23	20	16	
kW	1.08	1.10	1.14	1.18	1.17	1.19	1.23	1.27	1.24	1.27	1.31	1.36	1.31	1.34	1.39	1.44	1.37	1.40	1.45	1.50	1.42	1.45	1.50	1.56	
Amps	4.4	4.5	4.6	4.8	4.7	4.8	5.0	5.2	5.1	5.3	5.4	5.6	5.5	5.6	5.8	6.0	5.8	6.0	6.2	6.4	6.2	6.3	6.5	6.8	
HI PR	223	240	244	249	252	271	275	281	287	309	313	320	327	352	357	364	368	396	401	410	412	443	449	459	
Lo PR	119	123	134	143	123	127	138	147	127	131	143	152	130	134	147	156	133	137	150	159	136	140	153	163	

MBh	19.0	19.3	20.2	21.6	18.5	18.9	19.8	21.1	18.1	18.4	19.3	20.6	17.6	18.0	18.8	20.1	16.8	17.1	17.9	19.1	15.5	15.8	16.6	17.7
S/T	0.98	0.94	0.85	0.69	1.00	0.98	0.88	0.72	1.00	1.00	0.91	0.73	1.00	1.00	0.93	0.76	1.00	1.00	0.97	0.79	1.00	1.00	0.98	0.79
ΔT	25	25	23	20	25	25	24	21	25	25	24	21	24	24	24	21	23	23	24	20	21	22	22	19
kW	1.10	1.12	1.16	1.20	1.19	1.21	1.25	1.30	1.26	1.29	1.34	1.38	1.33	1.37	1.41	1.46	1.39	1.43	1.48	1.53	1.44	1.48	1.53	1.58
Amps	4.5	4.6	4.7	4.9	4.8	4.9	5.1	5.3	5.2	5.3	5.5	5.7	5.6	5.7	5.9	6.1	5.9	6.1	6.3	6.5	6.3	6.4	6.6	6.9
HI PR	228	245	248	254	258	277	281	287	293	315	319	326	334	359	364	372	375	404	409	418	420	452	458	468
Lo PR	122	125	137	146	125	129	141	150	129	133	146	155	133	137	150	159	135	140	153	162	139	143	156	166
MBh	18.4	18.8	19.6	21.0	18.0	18.3	19.2	20.5	17.5	17.9	18.7	20.0	17.1	17.4	18.3	19.5	16.3	16.6	17.4	18.5	15.1	15.4	16.1	17.2
S/T	0.93	0.90	0.81	0.66	0.97	0.93	0.84	0.68	0.99	0.96	0.86	0.70	1.00	0.99	0.89	0.72	1.00	1.00	0.93	0.75	1.00	1.00	0.93	0.76
ΔT	26	26	24	21	27	26	25	21	27	26	25	21	26	26	25	22	25	25	25	21	23	24	23	20
kW	1.09	1.11	1.15	1.19	1.18	1.20	1.24	1.29	1.25	1.28	1.33	1.37	1.32	1.35	1.40	1.45	1.38	1.41	1.46	1.51	1.43	1.47	1.52	1.57
Amps	4.4	4.5	4.7	4.8	4.8	4.9	5.0	5.2	5.2	5.3	5.5	5.7	5.5	5.7	5.8	6.1	5.9	6.0	6.2	6.4	6.2	6.4	6.6	6.8
HI PR	226	243	246	251	255	274	278	284	290	312	316	323	330	355	360	368	372	400	405	414	416	447	454	464
Lo PR	120	124	136	144	124	128	140	149	128	132	144	154	132	136	148	158	134	138	151	161	137	142	155	165
MBh	17.0	17.3	18.1	19.3	16.6	16.9	17.7	18.9	16.2	16.5	17.3	18.4	15.8	16.1	16.9	18.0	15.0	15.3	16.0	17.1	13.9	14.2	14.8	15.8
S/T	0.90	0.87	0.78	0.64	0.93	0.90	0.81	0.66	0.96	0.92	0.83	0.68	0.99	0.95	0.86	0.70	1.00	0.99	0.89	0.72	1.00	1.00	0.90	0.73
ΔT	26.8	26	25	22	27	27	25	22	27	27	25	22	27	27	25	22	26	26	26	22	24	25	23	20
kW	1.08	1.10	1.14	1.18	1.17	1.19	1.23	1.27	1.24	1.27	1.31	1.36	1.31	1.34	1.39	1.44	1.37	1.40	1.45	1.50	1.42	1.45	1.50	1.56
Amps	4.4	4.5	4.6	4.8	4.7	4.8	5.0	5.2	5.1	5.3	5.4	5.6	5.5	5.6	5.8	6.0	5.8	6.0	6.2	6.4	6.2	6.3	6.5	6.8
HI PR	223	240	244	249	252	271	275	281	287	309	313	320	327	352	357	364	368	396	401	410	412	443	449	459
Lo PR	119	123	134	143	123	127	138	147	127	131	143	152	130	134	147	156	133	137	150	159	136	140	153	163

IDB = Entering Indoor Dry Bulb Temperature
 High and low pressures are measured at the liquid and suction service valves.
 Shaded area reflects AHRI (TVA) conditions
 kW = Total system power
 Amps = outdoor unit amps (comp.+fan)

IDB	AIRFLOW	OUTDOOR AMBIENT TEMPERATURE																							
		65°F				75°F				85°F				95°F				105°F				115°F			
		59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71
70	MBh	23.5	24.4	26.7	-	23.0	23.8	26.1	-	22.4	23.2	25.5	-	21.9	22.7	24.8	-	20.8	21.5	23.6	-	19.3	20.0	21.9	-
	S/T	0.76	0.63	0.44	-	0.78	0.66	0.45	-	0.80	0.67	0.47	-	0.83	0.69	0.48	-	0.86	0.72	0.50	-	0.87	0.73	0.50	-
	ΔT	18	16	12	-	18	16	12	-	18	16	12	-	19	16	12	-	18	16	12	-	17	15	11	-
	KW	1.50	1.53	1.58	-	1.62	1.65	1.71	-	1.72	1.76	1.82	-	1.81	1.86	1.92	-	1.89	1.94	2.00	-	1.96	2.01	2.07	-
	Amps	5.9	6.0	6.2	-	6.4	6.5	6.7	-	6.9	7.1	7.3	-	7.4	7.5	7.8	-	7.8	8.0	8.3	-	8.3	8.5	8.7	-
	HI PR	237	255	258	-	268	288	292	-	304	327	332	-	347	373	378	-	390	419	425	-	437	470	476	-
	Lo PR	122	125	137	-	125	129	141	-	129	134	146	-	133	137	150	-	136	140	153	-	139	143	156	-
	MBh	22.8	23.7	25.9	-	22.3	23.1	25.3	-	21.8	22.6	24.7	-	21.2	22.0	24.1	-	20.2	20.9	22.9	-	18.7	19.4	21.2	-
	S/T	0.72	0.60	0.42	-	0.75	0.63	0.43	-	0.77	0.64	0.44	-	0.79	0.66	0.46	-	0.82	0.69	0.48	-	0.83	0.69	0.48	-
	ΔT	19	16	12	-	19	17	13	-	19	17	13	-	19	17	13	-	18	17	13	-	18	15	12	-
KW	1.49	1.52	1.57	-	1.61	1.64	1.69	-	1.71	1.75	1.80	-	1.80	1.84	1.90	-	1.88	1.92	1.98	-	1.94	1.99	2.06	-	
Amps	5.9	6.0	6.2	-	6.3	6.5	6.7	-	6.8	7.0	7.2	-	7.3	7.5	7.7	-	7.8	7.9	8.2	-	8.2	8.4	8.7	-	
HI PR	234	252	256	-	265	285	289	-	301	324	329	-	343	369	374	-	386	415	421	-	432	465	471	-	
Lo PR	120	124	136	-	124	128	140	-	128	132	144	-	132	136	148	-	134	138	151	-	138	142	155	-	
MBh	21.1	21.8	23.9	-	20.6	21.3	23.4	-	20.1	20.8	22.8	-	19.6	20.3	22.3	-	18.6	19.3	21.1	-	17.3	17.9	19.6	-	
S/T	0.70	0.58	0.40	-	0.72	0.60	0.42	-	0.74	0.62	0.43	-	0.76	0.64	0.44	-	0.79	0.66	0.46	-	0.80	0.67	0.46	-	
ΔT	19	17	13	-	20	17	13	-	20	17	13	-	20	17	13	-	19	17	13	-	18	16	12	-	
KW	1.48	1.51	1.56	-	1.59	1.63	1.68	-	1.69	1.73	1.79	-	1.78	1.82	1.89	-	1.86	1.90	1.97	-	1.93	1.97	2.04	-	
Amps	5.8	5.9	6.1	-	6.3	6.4	6.6	-	6.8	6.9	7.2	-	7.2	7.4	7.6	-	7.7	7.9	8.1	-	8.1	8.3	8.6	-	
HI PR	232	249	253	-	262	282	286	-	298	321	325	-	340	365	370	-	382	411	417	-	428	460	467	-	
Lo PR	119	123	134	-	123	127	138	-	127	131	143	-	130	134	147	-	133	137	150	-	136	140	153	-	

900	MBh	23.9	24.6	26.7	28.6	23.4	24.1	26.0	27.9	22.8	23.5	25.4	27.3	22.2	22.9	24.8	26.6	21.1	21.8	23.6	25.3	19.6	20.2	21.8	23.4
	S/T	0.86	0.77	0.58	0.37	0.89	0.80	0.60	0.39	0.91	0.82	0.62	0.40	0.94	0.84	0.64	0.41	0.98	0.88	0.66	0.43	0.99	0.88	0.67	0.43
	ΔT	21	19	16	11	21	20	16	11	21	20	16	11	21	20	16	11	21	19	16	11	20	18	15	10
	KW	1.50	1.53	1.58	1.63	1.62	1.65	1.71	1.77	1.72	1.76	1.82	1.88	1.81	1.86	1.92	1.98	1.89	1.94	2.00	2.07	1.96	2.01	2.07	2.15
	Amps	5.9	6.0	6.2	6.5	6.4	6.5	6.7	7.0	6.9	7.1	7.3	7.6	7.4	7.5	7.8	8.1	7.8	8.0	8.3	8.6	8.3	8.5	8.7	9.1
	HI PR	237	255	258	264	268	288	292	298	304	327	332	339	347	373	378	386	390	419	425	435	437	470	476	487
	Lo PR	122	125	137	146	125	129	141	150	129	134	146	155	133	137	150	159	136	140	153	163	139	143	156	167
	MBh	23.2	23.9	25.9	27.8	22.7	23.4	25.3	27.1	22.1	22.8	24.7	26.5	21.6	22.2	24.1	25.8	20.5	21.1	22.9	24.5	19.0	19.6	21.2	22.7
	S/T	0.82	0.73	0.56	0.36	0.85	0.76	0.58	0.37	0.87	0.78	0.59	0.38	0.90	0.81	0.61	0.39	0.93	0.84	0.63	0.41	0.94	0.84	0.64	0.41
	ΔT	22	20	17	11	22	20	17	12	22	20	17	12	22	21	17	12	22	20	17	11	21	19	16	11
KW	1.49	1.52	1.57	1.62	1.61	1.64	1.69	1.75	1.71	1.75	1.80	1.87	1.80	1.84	1.90	1.97	1.88	1.92	1.98	2.05	1.94	1.99	2.06	2.13	
Amps	5.9	6.0	6.2	6.4	6.3	6.5	6.7	6.9	6.8	7.0	7.2	7.5	7.3	7.5	7.7	8.0	7.8	7.9	8.2	8.5	8.2	8.4	8.7	9.0	
HI PR	234	252	256	261	265	285	289	295	301	324	329	336	343	369	374	382	386	415	421	430	432	465	471	482	
Lo PR	120	124	136	144	124	128	140	149	128	132	144	154	132	136	148	158	134	138	151	161	138	142	155	165	
MBh	21.4	22.1	23.9	25.6	20.9	21.6	23.3	25.0	20.4	21.0	22.8	24.4	19.9	20.5	22.2	23.8	18.9	19.5	21.1	22.7	17.5	18.1	19.6	21.0	
S/T	0.79	0.71	0.54	0.34	0.82	0.73	0.56	0.36	0.84	0.75	0.57	0.37	0.87	0.78	0.59	0.38	0.90	0.81	0.61	0.39	0.91	0.81	0.62	0.40	
ΔT	22	21	17	12	23	21	17	12	23	21	17	12	23	21	17	12	22	21	17	12	21	19	16	11	
KW	1.48	1.51	1.56	1.61	1.59	1.63	1.68	1.74	1.69	1.73	1.79	1.85	1.78	1.82	1.89	1.95	1.86	1.90	1.97	2.04	1.93	1.97	2.04	2.11	
Amps	5.8	5.9	6.1	6.3	6.3	6.4	6.6	6.8	6.8	6.9	7.2	7.4	7.2	7.4	7.6	7.9	7.7	7.9	8.1	8.4	8.1	8.3	8.6	8.9	
HI PR	232	249	253	259	262	282	286	292	298	321	325	332	340	365	370	379	382	411	417	426	428	460	467	477	
Lo PR	119	123	134	143	123	127	138	147	127	131	143	152	130	134	147	156	133	137	150	159	136	140	153	163	

IDB = Entering Indoor Dry Bulb Temperature
 High and low pressures are measured at the liquid and suction service valves.
 Shaded area reflects ACCA (TVA) conditions
 kW = Total system power
 Amps = outdoor unit amps (comp.+fan)

IDB	AIRFLOW	OUTDOOR AMBIENT TEMPERATURE																									
		65°F				75°F				85°F				95°F				105°F				115°F					
		59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71		
80	900	MBh	24.3	24.9	26.6	28.4	23.8	24.3	26.0	27.7	23.2	23.7	25.3	27.1	22.6	23.1	24.7	26.4	21.5	22.0	23.5	25.1	19.9	20.4	21.8	23.3	
		S/T	0.94	0.89	0.72	0.54	1.00	0.92	0.75	0.56	1.00	0.94	0.77	0.57	1.00	1.00	0.79	0.59	1.00	1.00	0.82	0.61	1.00	1.00	0.83	0.62	
		ΔT	23	22	20	16	24	23	20	16	24	23	20	16	23	24	20	16	22	22	22	20	16	20	21	18	15
		kW	1.50	1.53	1.58	1.63	1.62	1.65	1.71	1.77	1.72	1.76	1.82	1.88	1.81	1.86	1.92	1.98	1.89	1.89	1.94	2.00	2.07	1.96	2.01	2.07	2.15
		Amps	5.9	6.0	6.2	6.5	6.4	6.5	6.7	7.0	6.9	7.1	7.3	7.6	7.4	7.5	7.8	8.1	7.8	7.8	8.0	8.3	8.6	8.3	8.5	8.7	9.1
	HI PR	237	255	258	264	268	288	292	298	304	327	332	339	347	373	378	386	390	390	419	425	435	437	470	476	487	
	Lo PR	122	125	137	146	125	129	141	150	129	134	146	155	133	137	150	159	136	140	140	153	163	139	143	156	167	
	MBh	23.6	24.1	25.8	27.6	23.1	23.6	25.2	26.9	22.5	23.0	24.6	26.3	22.0	22.5	24.0	25.7	20.9	21.3	22.8	24.4	19.3	19.8	21.1	22.6		
	S/T	0.90	0.84	0.69	0.51	0.93	0.88	0.71	0.53	0.96	0.90	0.73	0.55	0.99	0.93	0.75	0.56	1.00	0.96	0.78	0.58	1.00	0.97	0.79	0.59		
	ΔT	24	23	20	16	25	24	21	16	25	24	21	16	25	24	21	17	24	24	22	19	16	22	22	19	15	
kW	1.49	1.52	1.57	1.62	1.61	1.64	1.69	1.75	1.71	1.75	1.80	1.87	1.80	1.84	1.90	1.97	1.88	1.88	1.92	1.98	2.05	1.94	1.99	2.06	2.13		
Amps	5.9	6.0	6.2	6.4	6.3	6.5	6.7	6.9	6.8	7.0	7.2	7.5	7.3	7.5	7.7	8.0	7.8	7.9	8.2	8.5	8.2	8.4	8.4	8.7	9.0		
HI PR	234	252	256	261	265	285	289	295	301	324	329	336	343	369	374	382	386	386	415	421	430	432	465	471	482		
Lo PR	120	124	136	144	124	128	140	149	128	132	144	154	132	136	148	158	134	138	138	151	161	138	142	155	165		
MBh	21.8	22.3	23.8	25.5	21.3	21.8	23.3	24.9	20.8	21.3	22.7	24.3	20.3	20.7	22.2	23.7	19.3	19.7	21.0	22.5	17.9	18.2	19.5	20.8			
S/T	0.87	0.81	0.66	0.50	0.90	0.84	0.69	0.51	0.92	0.87	0.70	0.53	0.95	0.89	0.73	0.54	0.99	0.93	0.75	0.56	1.00	0.93	0.76	0.57			
ΔT	25	24	21	17	25	24	21	17	25	24	21	17	25	24	21	17	25	24	21	17	16	23	22	19	16		
kW	1.48	1.51	1.56	1.61	1.59	1.63	1.68	1.74	1.69	1.73	1.79	1.85	1.78	1.82	1.89	1.95	1.86	1.86	1.90	1.97	2.04	1.93	1.97	2.04	2.11		
Amps	5.8	5.9	6.1	6.3	6.3	6.4	6.6	6.8	6.8	6.9	7.2	7.4	7.2	7.4	7.6	7.9	7.7	7.9	8.1	8.4	8.1	8.3	8.6	8.9			
HI PR	232	249	253	259	262	282	286	292	298	321	325	332	340	365	370	379	382	382	411	417	426	428	460	467	477		
Lo PR	119	123	134	143	123	127	138	147	127	131	143	152	130	134	147	156	133	137	137	150	159	136	140	153	163		

85	900	MBh	24.8	25.2	26.4	28.2	24.2	24.7	25.8	27.6	23.6	24.1	25.2	26.9	23.0	23.5	24.6	26.2	21.9	22.3	23.4	24.9	20.3	20.7	21.6	23.1	
		S/T	0.99	0.96	0.86	0.70	1.00	0.99	0.89	0.72	1.00	1.00	0.92	0.74	1.00	1.00	0.95	0.77	1.00	1.00	0.98	0.80	1.00	1.00	0.99	0.80	
		ΔT	25	25	23	20	25	25	24	20	24	25	24	20	24	24	24	21	21	22	23	23	20	21	21	22	19
		kW	1.50	1.53	1.58	1.63	1.62	1.65	1.71	1.77	1.72	1.76	1.82	1.88	1.81	1.86	1.92	1.98	1.89	1.89	1.94	2.00	2.07	1.96	2.01	2.07	2.15
		Amps	5.9	6.0	6.2	6.5	6.4	6.5	6.7	7.0	6.9	7.1	7.3	7.6	7.4	7.5	7.8	8.1	7.8	7.8	8.0	8.3	8.6	8.3	8.5	8.7	9.1
	HI PR	237	255	258	264	268	288	292	298	304	327	332	339	347	373	378	386	390	390	419	425	435	437	470	476	487	
	Lo PR	122	125	137	146	125	129	141	150	129	134	146	155	133	137	150	159	136	140	140	153	163	139	143	156	167	
	MBh	24.0	24.5	25.7	27.4	23.5	23.9	25.1	26.8	22.9	23.4	24.5	26.1	22.4	22.8	23.9	25.5	21.2	21.7	22.7	24.2	19.7	20.1	21.0	22.4		
	S/T	0.94	0.91	0.82	0.67	0.98	0.94	0.85	0.69	1.00	0.97	0.87	0.71	1.00	1.00	0.90	0.73	1.00	1.00	0.94	0.76	1.00	1.00	0.94	0.77		
	ΔT	26	26	24	21	26	26	25	21	26	26	25	21	26	26	25	21	24	24	25	24	21	23	23	23	20	
kW	1.49	1.52	1.57	1.62	1.61	1.64	1.69	1.75	1.71	1.75	1.80	1.87	1.80	1.84	1.90	1.97	1.88	1.88	1.92	1.98	2.05	1.94	1.99	2.06	2.13		
Amps	5.9	6.0	6.2	6.4	6.3	6.5	6.7	6.9	6.8	7.0	7.2	7.5	7.3	7.5	7.7	8.0	7.8	7.9	8.2	8.5	8.2	8.4	8.4	8.7	9.0		
HI PR	234	252	256	261	265	285	289	295	301	324	329	336	343	369	374	382	386	386	415	421	430	432	465	471	482		
Lo PR	120	124	136	144	124	128	140	149	128	132	144	154	132	136	148	158	134	138	138	151	161	138	142	155	165		
MBh	22.2	22.6	23.7	25.3	21.7	22.1	23.1	24.7	21.2	21.6	22.6	24.1	20.6	21.0	22.0	23.5	19.6	20.0	20.9	22.3	18.2	18.5	19.4	20.7			
S/T	0.91	0.88	0.79	0.64	0.94	0.91	0.82	0.67	0.97	0.93	0.84	0.68	1.00	0.96	0.87	0.71	1.00	1.00	0.90	0.73	1.00	1.00	0.91	0.74			
ΔT	26.5	26	25	21	27	26	25	22	27	26	25	22	27	27	25	22	26	26	26	25	21	24	24	23	20		
kW	1.48	1.51	1.56	1.61	1.59	1.63	1.68	1.74	1.69	1.73	1.79	1.85	1.78	1.82	1.89	1.95	1.86	1.86	1.90	1.97	2.04	1.93	1.97	2.04	2.11		
Amps	5.8	5.9	6.1	6.3	6.3	6.4	6.6	6.8	6.8	6.9	7.2	7.4	7.2	7.4	7.6	7.9	7.7	7.9	8.1	8.4	8.1	8.3	8.6	8.9			
HI PR	232	249	253	259	262	282	286	292	298	321	325	332	340	365	370	379	382	382	411	417	426	428	460	467	477		
Lo PR	119	123	134	143	123	127	138	147	127	131	143	152	130	134	147	156	133	137	137	150	159	136	140	153	163		

IDB = Entering Indoor Dry Bulb Temperature
 High and low pressures are measured at the liquid and suction service valves.
 Shaded area reflects AHRI (TVA) conditions
 kW = Total system power
 Amps = outdoor unit amps (comp.+fan)

IDB	AIRFLOW	OUTDOOR AMBIENT TEMPERATURE																								
		65°F				75°F				85°F				95°F				105°F				115°F				
		59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	
70	904	MBh	24.9	25.8	28.3	-	24.3	25.2	27.6	-	23.8	24.6	27.0	-	23.2	24.0	26.3	-	22.0	22.8	25.0	-	20.4	21.1	23.2	-
		S/T	0.72	0.60	0.41	-	0.74	0.62	0.43	-	0.76	0.64	0.44	-	0.79	0.66	0.45	-	0.82	0.68	0.47	-	0.82	0.69	0.48	-
		ΔT	18	16	12	-	18	16	12	-	18	16	12	-	19	16	12	-	18	16	12	-	17	15	11	-
		kW	1.50	1.53	1.58	-	1.61	1.65	1.70	-	1.72	1.75	1.81	-	1.81	1.85	1.91	-	1.88	1.93	1.99	-	1.95	2.00	2.06	-
		Amps	5.8	6.0	6.2	-	6.3	6.4	6.6	-	6.8	7.0	7.2	-	7.3	7.4	7.7	-	7.7	7.9	8.1	-	8.2	8.3	8.6	-
	HI PR	220	237	240	-	249	268	271	-	283	304	309	-	322	347	352	-	348	374	380	-	413	444	450	-	
	Lo PR	119	123	134	-	123	127	138	-	127	131	143	-	130	135	147	-	133	137	150	-	136	141	153	-	
	MBh	24.2	25.1	27.5	-	23.6	24.5	26.8	-	23.1	23.9	26.2	-	22.5	23.3	25.5	-	21.4	22.2	24.3	-	19.8	20.5	22.5	-	
	S/T	0.68	0.57	0.40	-	0.71	0.59	0.41	-	0.73	0.61	0.42	-	0.75	0.63	0.43	-	0.78	0.65	0.45	-	0.78	0.65	0.45	-	
	ΔT	19	16	12	-	19	17	13	-	19	17	13	-	19	17	13	-	19	17	13	-	18	15	12	-	
kW	1.49	1.52	1.57	-	1.60	1.64	1.69	-	1.70	1.74	1.80	-	1.79	1.83	1.89	-	1.87	1.91	1.97	-	1.93	1.98	2.04	-		
Amps	5.8	5.9	6.1	-	6.2	6.4	6.6	-	6.7	6.9	7.1	-	7.2	7.4	7.6	-	7.6	7.8	8.1	-	8.1	8.3	8.5	-		
HI PR	218	234	238	-	246	265	269	-	280	301	306	-	319	343	348	-	345	371	376	-	409	439	446	-		
Lo PR	118	122	133	-	122	125	137	-	126	130	142	-	129	133	145	-	132	136	148	-	135	139	152	-		
MBh	22.3	23.1	25.3	-	21.8	22.6	24.8	-	21.3	22.1	24.2	-	20.8	21.5	23.6	-	19.7	20.4	22.4	-	18.3	18.9	20.8	-		
S/T	0.66	0.55	0.38	-	0.68	0.57	0.39	-	0.70	0.58	0.40	-	0.72	0.60	0.42	-	0.75	0.63	0.43	-	0.76	0.63	0.44	-		
ΔT	19	17	13	-	20	17	13	-	20	17	13	-	20	17	13	-	20	17	13	-	18	16	12	-		
kW	1.47	1.51	1.55	-	1.59	1.62	1.67	-	1.69	1.73	1.78	-	1.78	1.82	1.88	-	1.85	1.89	1.96	-	1.92	1.96	2.03	-		
Amps	5.7	5.9	6.0	-	6.2	6.3	6.5	-	6.7	6.8	7.1	-	7.1	7.3	7.5	-	7.6	7.8	8.0	-	8.0	8.2	8.5	-		
HI PR	216	232	235	-	244	262	266	-	277	298	303	-	316	340	345	-	341	367	372	-	404	435	441	-		
Lo PR	117	121	132	-	120	124	136	-	125	128	140	-	128	132	144	-	130	134	147	-	134	138	150	-		

75	904	MBh	25.3	26.1	28.2	30.3	24.7	25.5	27.6	29.6	24.2	24.9	26.9	28.9	23.6	24.3	26.3	28.2	22.4	23.0	24.9	26.8	20.7	21.4	23.1	24.8
		S/T	0.81	0.73	0.55	0.35	0.84	0.75	0.57	0.37	0.87	0.77	0.59	0.38	0.89	0.80	0.60	0.39	0.93	0.83	0.63	0.40	0.93	0.84	0.63	0.41
		ΔT	21	19	16	11	21	20	16	11	21	20	16	11	21	20	16	11	21	19	16	11	20	18	15	10
		kW	1.50	1.53	1.58	1.63	1.61	1.65	1.70	1.76	1.72	1.75	1.81	1.87	1.81	1.85	1.91	1.97	1.88	1.93	1.99	2.06	1.95	2.00	2.06	2.13
		Amps	5.8	6.0	6.2	6.4	6.3	6.4	6.6	6.9	6.8	7.0	7.2	7.4	7.3	7.4	7.7	7.9	7.7	7.9	8.1	8.4	8.2	8.3	8.6	8.9
	HI PR	220	237	240	245	249	268	271	277	283	304	309	315	322	347	352	359	348	374	380	388	413	444	450	460	
	Lo PR	119	123	134	143	123	127	138	147	127	131	143	152	130	135	147	156	133	137	150	160	136	141	153	163	
	MBh	24.6	25.3	27.4	29.4	24.0	24.7	26.8	28.7	23.5	24.1	26.1	28.0	22.9	23.6	25.5	27.4	21.7	22.4	24.2	26.0	20.1	20.7	22.4	24.1	
	S/T	0.78	0.69	0.53	0.34	0.80	0.72	0.54	0.35	0.83	0.74	0.56	0.36	0.85	0.76	0.58	0.37	0.88	0.79	0.60	0.38	0.89	0.80	0.60	0.39	
	ΔT	22	20	17	11	22	20	17	12	22	20	17	12	22	21	17	12	22	20	17	12	21	19	16	11	
kW	1.49	1.52	1.57	1.62	1.60	1.64	1.69	1.74	1.70	1.74	1.80	1.86	1.79	1.83	1.89	1.96	1.87	1.91	1.97	2.04	1.93	1.98	2.04	2.11		
Amps	5.8	5.9	6.1	6.3	6.2	6.4	6.6	6.8	6.7	6.9	7.1	7.4	7.2	7.4	7.6	7.9	7.6	7.8	8.1	8.4	8.1	8.3	8.5	8.9		
HI PR	218	234	238	243	246	265	269	275	280	301	306	312	319	343	348	356	345	371	376	384	409	439	446	455		
Lo PR	118	122	133	142	122	125	137	146	126	130	142	151	129	133	145	155	132	136	148	158	135	139	152	162		
MBh	22.7	23.4	25.3	27.2	22.2	22.8	24.7	26.5	21.6	22.3	24.1	25.9	21.1	21.7	23.5	25.3	20.1	20.7	22.4	24.0	18.6	19.1	20.7	22.2		
S/T	0.75	0.67	0.51	0.33	0.78	0.69	0.53	0.34	0.80	0.71	0.54	0.35	0.82	0.73	0.56	0.36	0.85	0.76	0.58	0.37	0.86	0.77	0.58	0.37		
ΔT	22	21	17	12	23	21	17	12	23	21	17	12	23	21	17	12	23	21	17	12	21	19	16	11		
kW	1.47	1.51	1.55	1.60	1.59	1.62	1.67	1.73	1.69	1.73	1.78	1.84	1.78	1.82	1.88	1.94	1.85	1.89	1.96	2.02	1.92	1.96	2.03	2.10		
Amps	5.7	5.9	6.0	6.3	6.2	6.3	6.5	6.8	6.7	6.8	7.1	7.3	7.1	7.3	7.5	7.8	7.6	7.8	8.0	8.3	8.0	8.2	8.5	8.8		
HI PR	216	232	235	241	244	262	266	272	277	298	303	309	316	340	345	352	341	367	372	380	404	435	441	451		
Lo PR	117	121	132	140	120	124	136	144	125	128	140	149	128	132	144	153	130	134	147	156	134	138	150	160		

IDB = Entering Indoor Dry Bulb Temperature

High and low pressures are measured at the liquid and suction service valves.

Shaded area reflects ACCA (TVA) conditions

kW = Total system power
Amps = outdoor unit amps (comp.+fan)

Table with columns for Outdoor Ambient Temperature (65°F, 75°F, 85°F, 95°F, 105°F, 115°F) and Indoor Wet Bulb Temperature (59, 63, 67, 71). Rows include Airflow (Mbh, S/T, ΔT) and kW/Amps data for models 904, 800, and 696.

Table with columns for Outdoor Ambient Temperature (65°F, 75°F, 85°F, 95°F, 105°F, 115°F) and Indoor Wet Bulb Temperature (59, 63, 67, 71). Rows include Airflow (Mbh, S/T, ΔT) and kW/Amps data for models 904, 800, and 696.

IDB = Entering Indoor Dry Bulb Temperature
High and low pressures are measured at the liquid and suction service valves.
Shaded area reflects AHRI (TVA) conditions
kw = Total system power
Amps = outdoor unit amps (comp.+fan)

IDB	AIRFLOW	OUTDOOR AMBIENT TEMPERATURE																																			
		65°F						75°F						85°F						95°F						105°F						115°F					
		59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71								
70	1356	MBh	33.9	35.1	38.5	-	33.1	34.3	37.6	-	32.3	33.5	36.7	-	31.5	32.7	35.8	-	30.0	31.1	34.0	-	27.8	28.8	31.5	-	30.0	31.1	34.0	-	27.8	28.8	31.5	-			
		S/T	0.72	0.60	0.42	-	0.74	0.62	0.43	-	0.76	0.64	0.44	-	0.79	0.66	0.46	-	0.82	0.68	0.47	-	0.82	0.69	0.48	-	0.82	0.68	0.47	-	0.82	0.69	0.48	-			
		ΔT	17	14	11	-	17	14	11	-	17	14	11	-	17	15	11	-	17	15	11	-	16	13	10	-	17	14	11	-	16	13	10	-			
	1200	kW	2.14	2.18	2.25	-	2.31	2.36	2.43	-	2.45	2.51	2.59	-	2.58	2.64	2.73	-	2.69	2.76	2.85	-	2.79	2.85	2.95	-	2.69	2.76	2.85	-	2.79	2.85	2.95	-			
		Amps	8.1	8.3	8.6	-	8.8	9.0	9.3	-	9.5	9.7	10.0	-	10.1	10.4	10.7	-	10.8	11.1	11.4	-	11.4	11.7	12.1	-	10.8	11.1	11.4	-	11.4	11.7	12.1	-			
		HI PR	232	249	253	-	262	282	286	-	298	321	325	-	340	365	370	-	367	394	400	-	435	467	474	-	367	394	400	-	435	467	474	-			
	1043	MBh	30.4	31.5	34.5	-	29.7	30.8	33.7	-	29.0	30.0	32.9	-	28.3	29.3	32.1	-	26.9	27.8	30.5	-	24.9	25.8	28.2	-	26.9	27.8	30.5	-	24.9	25.8	28.2	-			
		S/T	0.66	0.55	0.38	-	0.68	0.57	0.40	-	0.70	0.59	0.41	-	0.72	0.61	0.42	-	0.75	0.63	0.44	-	0.76	0.63	0.44	-	0.75	0.63	0.44	-	0.76	0.63	0.44	-			
		ΔT	18	15	12	-	18	15	12	-	18	16	12	-	18	16	12	-	18	15	12	-	17	14	11	-	18	15	12	-	17	14	11	-			

75	1356	MBh	34.5	35.5	38.4	41.2	33.7	34.7	37.5	40.3	32.9	33.8	36.6	39.3	32.1	33.0	35.7	38.4	30.5	31.4	34.0	36.4	28.2	29.1	31.5	33.8	30.5	31.4	34.0	36.4	28.2	29.1	31.5	33.8
		S/T	0.82	0.73	0.55	0.36	0.85	0.76	0.57	0.37	0.87	0.78	0.59	0.38	0.90	0.80	0.61	0.39	0.93	0.83	0.63	0.40	0.94	0.84	0.63	0.41	0.93	0.83	0.63	0.40	0.94	0.84	0.63	0.41
		ΔT	19	18	14	10	19	18	15	10	19	18	15	10	19	18	15	10	19	18	14	10	18	17	14	9	19	18	14	10	18	17	14	9
	1200	kW	2.14	2.18	2.25	2.33	2.31	2.36	2.43	2.51	2.45	2.51	2.59	2.68	2.58	2.64	2.73	2.82	2.69	2.76	2.85	2.95	2.79	2.85	2.95	3.05	2.69	2.76	2.85	2.95	2.79	2.85	2.95	3.05
		Amps	8.1	8.3	8.6	8.9	8.8	9.0	9.3	9.6	9.5	9.7	10.0	10.4	10.1	10.4	10.7	11.1	10.8	11.1	11.4	11.9	11.4	11.7	12.1	12.6	10.8	11.1	11.4	11.9	11.4	11.7	12.1	12.6
		HI PR	232	249	253	259	262	282	286	292	298	321	325	332	340	365	370	379	367	394	400	409	435	467	474	484	367	394	400	409	435	467	474	484
	1043	MBh	33.5	34.5	37.3	40.0	32.7	33.7	36.4	39.1	31.9	32.9	35.6	38.2	31.1	32.1	34.7	37.2	29.6	30.5	33.0	35.4	27.4	28.2	30.5	32.8	29.6	30.5	33.0	35.4	27.4	28.2	30.5	32.8
		S/T	0.78	0.70	0.53	0.34	0.81	0.72	0.55	0.35	0.83	0.74	0.56	0.36	0.85	0.76	0.58	0.37	0.89	0.79	0.60	0.39	0.89	0.80	0.61	0.39	0.89	0.79	0.60	0.39	0.89	0.80	0.61	0.39
		ΔT	20	18	15	10	20	19	15	11	20	19	15	11	20	19	15	11	20	19	15	10	19	17	14	10	20	19	15	10	19	17	14	10

IDB = Entering Indoor Dry Bulb Temperature
 High and low pressures are measured at the liquid and suction service valves.
 Shaded area reflects ACCA (TVA) conditions
 kW = Total system power
 Amps = outdoor unit amps (comp.+fan)

IDB AIRFLOW		OUTDOOR AMBIENT TEMPERATURE																																																																																																																			
		65°F						75°F						85°F						95°F						105°F						115°F																																																																																					
		59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71																																																																																								
		ENTERING INDOOR WET BULB TEMPERATURE																																																																																																																			
1350		39.3	40.7	44.6	-	38.3	39.7	43.5	-	37.4	38.8	42.5	-	36.5	37.8	41.5	-	34.7	36.0	39.4	-	32.1	33.3	36.5	-	0.73	0.61	0.42	-	0.76	0.63	0.44	-	0.78	0.65	0.45	-	0.80	0.67	0.47	-	0.83	0.70	0.48	-	0.84	0.70	0.49	-	2.0	17	13	-	2.0	17	13	-	3.09	3.17	3.28	-	3.21	3.28	3.40	-	9.9	10.1	10.4	-	10.7	10.9	11.3	-	11.6	11.9	12.3	-	12.4	12.7	13.1	-	13.2	13.5	14.0	-	351	377	398	-	387	417	440	-	107	114	124	-	113	120	132	-	118	125	137	-	124	132	144	-	130	138	150	-	134	143	156	-
70		38.7	40.1	43.9	-	37.8	39.2	42.9	-	36.9	38.2	41.9	-	36.0	37.3	40.9	-	34.2	35.4	38.8	-	31.7	32.8	35.9	-	0.70	0.59	0.41	-	0.73	0.61	0.42	-	0.75	0.62	0.43	-	0.77	0.64	0.45	-	0.80	0.67	0.46	-	0.81	0.67	0.47	-	2.1	18	14	-	2.1	18	14	-	3.07	3.15	3.26	-	3.19	3.26	3.38	-	9.8	10.0	10.4	-	10.6	10.9	11.2	-	11.5	11.8	12.2	-	12.3	12.6	13.0	-	13.1	13.4	13.9	-	348	375	396	-	385	414	437	-	106	113	124	-	112	120	131	-	117	124	136	-	123	131	143	-	129	137	149	-	133	142	155	-
1050		35.7	37.0	40.5	-	34.9	36.1	39.6	-	34.0	35.3	38.6	-	33.2	34.4	37.7	-	31.5	32.7	35.8	-	29.2	30.3	33.2	-	0.68	0.57	0.39	-	0.70	0.59	0.41	-	0.72	0.60	0.42	-	0.74	0.62	0.43	-	0.77	0.64	0.45	-	0.78	0.65	0.45	-	2.1	18	14	-	2.1	18	14	-	2.99	3.06	3.17	-	3.10	3.18	3.29	-	9.5	9.8	10.1	-	10.3	10.6	10.9	-	11.2	11.5	11.8	-	12.0	12.3	12.7	-	300	323	341	-	338	363	384	-	103	110	120	-	109	116	127	-	119	127	138	-	125	133	145	-	129	137	149	-	133	142	155	-				

1350		39.92	41.10	44.49	47.75	38.99	40.14	43.45	46.64	38.06	39.19	42.42	45.52	37.13	38.23	41.38	44.41	35.28	36.32	39.31	42.19	32.68	33.64	36.42	39.08	0.83	0.75	0.56	0.36	0.86	0.77	0.58	0.38	0.89	0.79	0.60	0.39	0.91	0.82	0.62	0.40	0.95	0.85	0.64	0.41	0.96	0.86	0.65	0.42	2.3	21	17	12	2.3	21	17	12	2.99	3.06	3.16	3.27	3.12	3.19	3.31	3.42	3.24	3.31	3.43	3.55	10.0	10.2	10.5	10.9	10.8	11.0	11.4	11.8	12.5	12.8	13.2	13.7	13.3	13.6	14.1	14.6	14.1	14.4	14.9	15.5	21.7	23.3	24.6	25.7	24.3	26.2	27.6	28.8	31.5	33.9	35.8	37.3	35.4	38.1	40.2	42.0	39.1	42.1	44.5	46.4	108	115	126	134	114	122	133	142	125	133	145	154	131	139	152	162	135	144	157	167								
75		39.3	40.5	43.8	47.0	38.4	39.6	42.8	45.9	37.5	38.6	41.8	44.9	36.6	37.7	40.8	43.8	34.8	35.8	38.7	41.6	32.2	33.1	35.9	38.5	0.80	0.71	0.54	0.35	0.83	0.74	0.56	0.36	0.85	0.76	0.57	0.37	0.88	0.78	0.59	0.38	0.91	0.81	0.62	0.40	0.92	0.82	0.62	0.40	0.95	0.85	0.64	0.41	0.96	0.86	0.65	0.42	2.4	22	18	13	2.4	22	18	13	2.97	3.04	3.14	3.25	3.10	3.17	3.28	3.40	3.22	3.29	3.41	3.53	9.9	10.1	10.5	10.9	10.7	11.0	11.3	11.7	12.4	12.7	13.1	13.6	13.2	13.5	14.0	14.5	14.0	14.4	14.8	15.4	21.5	23.1	24.4	25.5	24.1	26.0	27.4	28.6	31.3	33.6	35.5	37.0	35.2	37.8	40.0	41.7	38.9	41.8	44.2	46.1	108	114	125	133	114	121	132	141	124	132	144	153	130	138	151	161	134	143	156	166
1050		36.3	37.4	40.5	43.4	35.5	36.5	39.5	42.4	34.6	35.6	38.6	41.4	33.8	34.8	37.6	40.4	32.1	33.0	35.8	38.4	29.7	30.6	33.1	35.5	0.77	0.69	0.52	0.34	0.80	0.71	0.54	0.35	0.82	0.73	0.55	0.36	0.84	0.76	0.57	0.37	0.87	0.78	0.59	0.38	0.90	0.81	0.62	0.40	0.92	0.83	0.63	0.41	0.93	0.84	0.64	0.42	2.4	23	19	13	2.5	23	19	13	2.89	2.96	3.06	3.17	3.02	3.09	3.20	3.31	3.13	3.20	3.32	3.43	9.6	9.9	10.2	10.6	10.4	10.7	11.0	11.4	12.1	12.4	12.8	13.3	12.9	13.2	13.6	14.1	13.6	14.0	14.4	15.0	20.9	22.4	23.7	24.7	23.4	25.2	26.6	27.7	30.3	32.6	34.5	35.9	34.1	36.7	38.8	40.4	37.7	40.6	42.8	44.7	104	111	121	129	110	117	128	136	120	128	140	149	126	134	146	156	130	139	151	161

IDB = Entering Indoor Dry Bulb Temperature
 High and low pressures are measured at the liquid and suction service valves.
 Shaded area reflects ACCA (TVA) conditions
 kW = Total system power
 Amps = outdoor unit amps (comp.+fan)

IDB	AIRFLOW	OUTDOOR AMBIENT TEMPERATURE																																																																																																																																																																																																																																																																																																																																																
		65°F					75°F					85°F					95°F					105°F					115°F																																																																																																																																																																																																																																																																																																																							
		59	63	67	71	75	59	63	67	71	75	59	63	67	71	75	59	63	67	71	75	59	63	67	71	75	59	63	67	71	75																																																																																																																																																																																																																																																																																																																			
		40.63	41.51	44.35	47.41	39.68	40.55	43.32	46.31	38.74	39.58	42.29	45.21	37.79	38.62	41.26	44.11	35.90	36.69	39.20	41.90	33.26	33.98	36.31	38.81	0.91	0.86	0.70	0.52	0.95	0.89	0.72	0.54	0.97	0.91	0.74	0.55	1.00	0.94	0.77	0.57	1.00	0.98	0.79	0.59	1.00	0.98	0.80	0.60	2.47	2.53	2.62	2.70	2.68	2.74	2.83	2.93	2.79	2.86	2.92	3.02	3.13	3.01	3.08	3.19	3.30	3.15	3.22	3.33	3.45	3.26	3.34	3.46	3.58	2.19	2.35	2.49	2.59	2.45	2.64	2.79	2.91	2.79	3.00	3.17	3.31	3.18	3.42	3.61	3.77	3.58	3.85	4.06	4.24	3.95	4.25	4.49	4.68	1.09	1.16	1.27	1.35	1.16	1.23	1.34	1.43	1.20	1.28	1.39	1.49	1.26	1.34	1.47	1.56	1.32	1.41	1.54	1.64	1.37	1.45	1.59	1.69	0.88	0.82	0.67	0.50	0.91	0.85	0.69	0.52	0.93	0.87	0.71	0.53	0.96	0.90	0.73	0.55	1.00	0.93	0.76	0.57	1.00	0.94	0.77	0.57	2.46	2.52	2.60	2.69	2.66	2.72	2.81	2.91	2.84	2.90	3.00	3.11	3.00	3.07	3.17	3.28	3.13	3.20	3.31	3.43	3.24	3.32	3.44	3.56	2.17	2.34	2.47	2.57	2.44	2.62	2.77	2.89	2.77	2.98	3.15	3.29	3.16	3.40	3.59	3.74	3.55	3.82	4.04	4.21	3.92	4.22	4.46	4.65	1.09	1.16	1.26	1.34	1.15	1.22	1.33	1.42	1.19	1.27	1.39	1.48	1.25	1.33	1.46	1.55	1.31	1.40	1.52	1.62	1.36	1.44	1.58	1.68	36.9	37.8	40.3	43.1	36.1	36.9	39.4	42.1	35.2	36.0	38.5	41.1	34.4	35.1	37.5	40.1	32.6	33.4	35.6	38.1	30.2	30.9	33.0	35.3	0.84	0.79	0.64	0.48	0.87	0.82	0.67	0.50	0.90	0.84	0.68	0.51	0.93	0.87	0.71	0.53	0.96	0.90	0.73	0.55	0.97	0.91	0.74	0.55	2.40	2.45	2.53	2.62	2.59	2.65	2.74	2.84	2.77	2.83	2.93	3.03	2.92	2.99	3.09	3.20	3.05	3.12	3.23	3.34	3.16	3.23	3.35	3.46	2.11	2.27	2.39	2.50	2.36	2.54	2.69	2.80	2.69	2.89	3.06	3.19	3.06	3.30	3.48	3.63	3.45	3.71	3.92	4.08	3.81	4.10	4.33	4.51	1.05	1.12	1.22	1.30	1.11	1.18	1.29	1.38	1.16	1.23	1.34	1.43	1.22	1.29	1.41	1.50	1.27	1.35	1.48	1.58	1.32	1.40	1.53	1.63

		41.34	42.14	44.13	47.08	40.38	41.16	43.11	45.99	39.41	40.18	42.08	44.89	38.45	39.20	41.05	43.80	36.53	37.24	39.00	41.61	33.84	34.49	36.13	38.54	0.96	0.92	0.83	0.68	0.99	0.96	0.86	0.70	0.98	0.94	0.85	0.69	1.00	1.00	0.92	0.74	1.00	1.00	0.95	0.77	1.00	1.00	0.96	0.78	2.50	2.55	2.64	2.73	2.70	2.76	2.86	2.96	2.88	2.95	3.05	3.16	3.04	3.11	3.22	3.33	3.18	3.25	3.36	3.48	3.29	3.37	3.49	3.61	2.10	2.28	2.51	2.62	2.48	2.67	2.82	2.94	2.82	3.03	3.20	3.34	3.21	3.46	3.65	3.81	3.61	3.89	4.11	4.28	3.99	4.30	4.54	4.73	1.10	1.18	1.28	1.37	1.17	1.24	1.36	1.44	1.21	1.29	1.41	1.50	1.27	1.36	1.48	1.58	1.34	1.42	1.55	1.65	1.38	1.47	1.60	1.71	40.7	41.5	43.5	46.4	39.8	40.5	42.5	45.3	38.8	39.6	41.5	44.2	37.9	38.6	40.4	43.1	36.0	36.7	38.4	41.0	33.3	34.0	35.6	38.0	0.92	0.89	0.80	0.65	0.95	0.92	0.83	0.67	0.98	0.94	0.85	0.69	1.00	0.97	0.88	0.71	1.00	1.00	0.91	0.74	1.00	1.00	0.92	0.74	2.48	2.54	2.62	2.71	2.68	2.75	2.84	2.94	2.86	2.93	3.03	3.14	3.02	3.09	3.20	3.31	3.16	3.23	3.34	3.46	3.27	3.35	3.47	3.59	2.10	2.28	2.51	2.62	2.46	2.65	2.80	2.92	2.80	3.01	3.18	3.32	3.19	3.43	3.62	3.78	3.59	3.86	4.08	4.25	3.96	4.27	4.50	4.70	1.10	1.17	1.27	1.36	1.16	1.23	1.35	1.43	1.20	1.28	1.40	1.49	1.27	1.35	1.47	1.57	1.33	1.41	1.54	1.64	1.37	1.46	1.59	1.70	37.6	38.3	40.1	42.8	36.7	37.4	39.2	41.8	35.8	36.5	38.3	40.8	35.0	35.6	37.3	39.8	33.2	33.9	35.5	37.8	30.8	31.4	32.9	35.0	0.88	0.85	0.77	0.63	0.92	0.88	0.80	0.65	0.94	0.91	0.82	0.66	0.97	0.94	0.85	0.69	1.00	0.97	0.88	0.71	1.00	0.98	0.88	0.72	2.42	2.47	2.56	2.64	2.62	2.67	2.77	2.86	2.79	2.85	2.95	3.05	2.94	3.01	3.12	3.22	3.07	3.15	3.25	3.37	3.19	3.26	3.38	3.49	2.13	2.29	2.42	2.52	2.39	2.57	2.71	2.83	2.72	2.92	3.09	3.22	3.09	3.33	3.52	3.67	3.48	3.74	3.95	4.12	3.85	4.14	4.37	4.56	1.06	1.13	1.24	1.32	1.12	1.20	1.31	1.39	1.17	1.24	1.36	1.45	1.23	1.31	1.43	1.52	1.29	1.37	1.49	1.59	1.33	1.42	1.55	1.65
--	--	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------

IDB = Entering Indoor Dry Bulb Temperature
 High and low pressures are measured at the liquid and suction service valves.
 Shaded area reflects AHRI (TVA) conditions
 kW = Total system power
 Amps = outdoor unit amps (comp.+fan)

OUTDOOR UNIT	INDOOR UNITS		COOLING RATINGS				CFM	AHRI #
	COILS/AIR HANDLERS	FURNACES	TOTAL ¹	SENS. ¹	SEER ²	EER ³		
DSXC16 0241A*	AVPTC30C14A*		23,000	16,800	16.0	12.5	830	5924460
	CA*F3636*6D*+MBVC1200**-1A*+TXV		24,000	17,600	16.0	13.0	820	4392752
	CA*F3636*6D*+TXV	G*VC80604B*B*	24,000	17,600	16.0	13.0	820	5038827
	CA*F3636*6D*+TXV	A*VC80604B*B*	24,000	17,600	16.0	13.0	820	5039091
	CA*F3636*6D*+TXV	ADVC80603B*B*	24,000	17,600	16.0	13.0	810	6497622
	CA*F3636*6D*+TXV	G*VC960403BNA*	24,000	17,600	16.0	13.0	810	7356100
	CA*F3636*6D*+TXV	G*VC960603BNA*	24,000	17,600	16.0	13.0	815	7356105
	CA*F3636*6D*+TXV	G*VC960803BNA*	24,000	17,600	16.0	13.0	810	7356110
	CA*F3636*6D*+TXV	G*VM970603BNA*	24,000	17,600	16.0	13.0	815	7356176
	CA*F3636*6D*+TXV	G*VM970803BNA*	24,000	17,600	16.0	13.0	810	7356181
	CA*F3636*6D*+TXV	A*VC960403BNA*	24,000	17,600	16.0	13.0	810	7356242
	CA*F3636*6D*+TXV	A*VC960603BNA*	24,000	17,600	16.0	13.0	815	7356247
	CA*F3636*6D*+TXV	A*VC960803BNA*	24,000	17,600	16.0	13.0	810	7356252
	CA*F3636*6D*+TXV	A*VM970603BNA*	24,000	17,600	16.0	13.0	815	7356318
	CA*F3636*6D*+TXV	A*VM970803BNA*	24,000	17,600	16.0	13.0	810	7356323
	CA*F3636*6D*+TXV	G*EC960302BNA*	24,000	17,600	16.0	13.0	800	7366058
	CA*F3636*6D*+TXV	G*EC960402BNA*	24,000	17,600	16.0	13.0	850	7366061
	CA*F3636*6D*+TXV	G*EC960603BNA*	24,000	17,600	16.0	13.0	800	7366064
	CA*F3636*6D*+TXV	G*EC960803BNA*	24,000	17,600	16.0	13.0	800	7366067
	CA*F3636*6D*+TXV	A*EC960302BNA*	24,000	17,600	16.0	13.0	800	7366097
	CA*F3636*6D*+TXV	A*EC960402BNA*	24,000	17,600	16.0	13.0	850	7366100
	CA*F3636*6D*+TXV	A*EC960603BNA*	24,000	17,600	16.0	13.0	800	7366103
	CA*F3636*6D*+TXV	A*EC960803BNA*	24,000	17,600	16.0	13.0	800	7366106
	CA*F3642*6D*+TXV	A*VC80604B*B*	24,000	17,600	16.0	13.0	820	5039010
	CA*F3642*6D*+TXV	G*VC80604B*B*	24,000	17,600	16.0	13.0	820	5039220
	CAPT3131*4A*	G*VC960403BNA*	23,400	17,100	15.5	12.5	810	7356101
	CAPT3131*4A*	G*VC960603BNA*	23,400	17,100	15.5	12.5	815	7356106
	CAPT3131*4A*	G*VC960803BNA*	23,400	17,100	15.5	12.5	810	7356111
	CAPT3131*4A*	G*VM970603BNA*	23,400	17,100	15.5	12.5	815	7356177
	CAPT3131*4A*	G*VM970803BNA*	23,400	17,100	15.5	12.5	810	7356182
	CAPT3131*4A*	A*VC960403BNA*	23,400	17,100	15.5	12.5	810	7356243
	CAPT3131*4A*	A*VC960603BNA*	23,400	17,100	15.5	12.5	815	7356248
	CAPT3131*4A*	A*VC960803BNA*	23,400	17,100	15.5	12.5	810	7356253
	CAPT3131*4A*	A*VM970603BNA*	23,400	17,100	15.5	12.5	815	7356319
	CAPT3131*4A*	A*VM970803BNA*	23,400	17,100	15.5	12.5	810	7356324
	CAPT3743*4A*	G*EC960302BNA*	24,200	17,700	16.0	13.0	800	7366059
	CAPT3743*4A*	G*EC960402BNA*	24,200	17,700	16.0	13.0	850	7366062
	CAPT3743*4A*	G*EC960603BNA*	24,200	17,700	16.0	13.0	800	7366065
	CAPT3743*4A*	G*EC960803BNA*	24,200	17,700	16.0	13.0	800	7366068
	CAPT3743*4A*	A*EC960302BNA*	24,200	17,700	16.0	13.0	800	7366098
	CAPT3743*4A*	A*EC960402BNA*	24,200	17,700	16.0	13.0	850	7366101
	CAPT3743*4A*	A*EC960603BNA*	24,200	17,700	16.0	13.0	800	7366104
CAPT3743*4A*	A*EC960803BNA*	24,200	17,700	16.0	13.0	800	7366107	
CHPF3636B6C*+MBVC1200**-1A*+TXV		24,000	17,600	16.0	13.0	820	3653937	
CHPF3636B6C*+TXV	G*VC80604B*B*	24,000	17,600	16.0	13.0	820	5039090	
CHPF3636B6C*+TXV	A*VC80604B*B*	24,000	17,600	16.0	13.0	820	5039103	
CHPF3636B6C*+TXV	G*VC960403BNA*	24,000	17,600	16.0	13.0	810	7356102	
CHPF3636B6C*+TXV	G*VC960603BNA*	24,000	17,600	16.0	13.0	815	7356107	
CHPF3636B6C*+TXV	G*VC960803BNA*	24,000	17,600	16.0	13.0	810	7356112	
CHPF3636B6C*+TXV	G*VM970603BNA*	24,000	17,600	16.0	13.0	815	7356178	
CHPF3636B6C*+TXV	G*VM970803BNA*	24,000	17,600	16.0	13.0	810	7356183	
CHPF3636B6C*+TXV	A*VC960403BNA*	24,000	17,600	16.0	13.0	810	7356244	

See Notes on Page 26.

OUTDOOR UNIT	INDOOR UNITS		COOLING RATINGS				CFM	AHRI #
	COILS/AIR HANDLERS	FURNACES	TOTAL ¹	SENS. ¹	SEER ²	EER ³		
DSXC16 0241A* (cont.)	CHPF3636B6C*+TXV	A*VC960603BNA*	24,000	17,600	16.0	13.0	815	7356249
	CHPF3636B6C*+TXV	A*VC960803BNA*	24,000	17,600	16.0	13.0	810	7356254
	CHPF3636B6C*+TXV	A*VM970603BNA*	24,000	17,600	16.0	13.0	815	7356320
	CHPF3636B6C*+TXV	A*VM970803BNA*	24,000	17,600	16.0	13.0	810	7356325
	CHPF3636B6C*+TXV	G*EC960302BNA*	24,000	17,600	16.0	13.0	800	7366060
	CHPF3636B6C*+TXV	G*EC960402BNA*	24,000	17,600	16.0	13.0	850	7366063
	CHPF3636B6C*+TXV	G*EC960603BNA*	24,000	17,600	16.0	13.0	800	7366066
	CHPF3636B6C*+TXV	G*EC960803BNA*	24,000	17,600	16.0	13.0	800	7366069
	CHPF3636B6C*+TXV	A*EC960302BNA*	24,000	17,600	16.0	13.0	800	7366099
	CHPF3636B6C*+TXV	A*EC960402BNA*	24,000	17,600	16.0	13.0	850	7366102
	CHPF3636B6C*+TXV	A*EC960603BNA*	24,000	17,600	16.0	13.0	800	7366105
	CHPF3636B6C*+TXV	A*EC960803BNA*	24,000	17,600	16.0	13.0	800	7366108
	CSCF3036N6D*+TXV	A*VC80604B*B*	24,000	17,600	16.0	13.0	820	6497642
	CSCF3036N6D*+TXV	G*VC80604B*B*	24,000	17,600	16.0	13.0	820	6497646
	CSCF3036N6D*+TXV	G*VC960403BNA*	24,000	17,600	15.5	12.5	810	7356103
	CSCF3036N6D*+TXV	G*VC960603BNA*	24,000	17,600	15.5	12.5	815	7356108
	CSCF3036N6D*+TXV	G*VC960803BNA*	24,000	17,600	15.5	12.5	810	7356113
	CSCF3036N6D*+TXV	G*VM970603BNA*	24,000	17,600	15.5	12.5	815	7356179
	CSCF3036N6D*+TXV	G*VM970803BNA*	24,000	17,600	15.5	12.5	810	7356184
	CSCF3036N6D*+TXV	A*VC960403BNA*	24,000	17,600	15.5	12.5	810	7356245
	CSCF3036N6D*+TXV	A*VC960603BNA*	24,000	17,600	15.5	12.5	815	7356250
	CSCF3036N6D*+TXV	A*VC960803BNA*	24,000	17,600	15.5	12.5	810	7356255
	CSCF3036N6D*+TXV	A*VM970603BNA*	24,000	17,600	15.5	12.5	815	7356321
	CSCF3036N6D*+TXV	A*VM970803BNA*	24,000	17,600	15.5	12.5	810	7356326
	CSCF3642N6D*+TXV	A*VC80604B*B*	24,000	17,600	16.0	13.0	820	5948539
	CSCF3642N6D*+TXV	G*VC80604B*B*	24,000	17,600	16.0	13.0	820	5948540
	CSCF3642N6D*+TXV	G*VC960403BNA*	24,000	17,600	16.0	13.0	810	7356104
	CSCF3642N6D*+TXV	G*VC960603BNA*	24,000	17,600	16.0	13.0	815	7356109
	CSCF3642N6D*+TXV	G*VC960803BNA*	24,000	17,600	16.0	13.0	810	7356114
	CSCF3642N6D*+TXV	G*VM970603BNA*	24,000	17,600	16.0	13.0	815	7356180
	CSCF3642N6D*+TXV	G*VM970803BNA*	24,000	17,600	16.0	13.0	810	7356185
	CSCF3642N6D*+TXV	A*VC960403BNA*	24,000	17,600	16.0	13.0	810	7356246
	CSCF3642N6D*+TXV	A*VC960603BNA*	24,000	17,600	16.0	13.0	815	7356251
	CSCF3642N6D*+TXV	A*VC960803BNA*	24,000	17,600	16.0	13.0	810	7356256
	CSCF3642N6D*+TXV	A*VM970603BNA*	24,000	17,600	16.0	13.0	815	7356322
	CSCF3642N6D*+TXV	A*VM970803BNA*	24,000	17,600	16.0	13.0	810	7356327
DSXC16 0361A*	AVPTC42D14A*		35,000	25,200	16.0	12.2	1,200	5924363
	AVPTC48C14A*		34,400	24,800	15.0	12.2	1,100	7079238
	AVPTC48D14A*		36,000	25,800	16.0	12.5	1,200	5924364
	CA*F3642*6D*+MBVC1600**-1A*+TXV		35,000	25,200	16.0	12.5	1,200	3880067
	CA*F3642*6D*+TXV	A*VC80805C*B*	35,000	25,200	16.0	12.5	1,190	6497652
	CA*F3642*6D*+TXV	ADVC80603B*B*	34,000	24,400	16.0	12.5	1,190	6497662
	CA*F3642*6D*+TXV	ADVC80805C*B*	35,000	25,200	16.0	12.5	1,190	6497663
	CA*F3642*6D*+TXV	G*VC80805C*B*	35,000	25,200	16.0	12.5	1,190	6497664
	CA*F3743*6D*+MBVC1600**-1A*+TXV		35,000	25,200	16.0	12.5	1,100	4415027
	CA*F3743*6D*+TXV	A*VC80604B*B*	34,000	24,400	16.0	12.5	1,220	5038932
	CA*F3743*6D*+TXV	G*VC80604B*B*	34,000	24,400	16.0	12.5	1,220	5039113
	CA*F3743*6D*+TXV	A*VC80805C*B*	34,000	24,400	16.0	12.5	1,190	6497670
	CA*F3743*6D*+TXV	ADVC80805C*B*	34,000	24,400	16.0	12.5	1,190	6497676
	CA*F3743*6D*+TXV	G*VC80805C*B*	34,000	24,400	16.0	12.5	1,190	6497677
	CA*F3743*6D*+TXV	G*VC961205DNA*	34,200	24,600	15.5	12.2	1,115	7356140
	CA*F3743*6D*+TXV	G*VM971205DNA*	34,200	24,600	15.5	12.2	1,115	7356206

See Notes on Page 26.

OUTDOOR UNIT	INDOOR UNITS		COOLING RATINGS				CFM	AHRI #
	COILS/AIR HANDLERS	FURNACES	TOTAL ¹	SENS. ¹	SEER ²	EER ³		
DSXC16 0361A* (cont.)	CA*F3743*6D*+TXV	A*VC960804CNA*	34,600	24,800	16.0	12.2	1,125	7356272
	CA*F3743*6D*+TXV	A*VC961205DNA*	34,200	24,600	15.5	12.2	1,115	7356282
	CA*F3743*6D*+TXV	A*VM970804CNA*	34,600	24,800	16.0	12.2	1,125	7356338
	CA*F3743*6D*+TXV	A*VM971205DNA*	34,200	24,600	15.5	12.2	1,115	7356348
	CA*F3743*6D*+TXV	G*EC961004CNA*	34,800	25,000	16.0	12.3	1,150	7366079
	CA*F3743*6D*+TXV	G*EC961205DNA*	34,800	25,000	15.5	12.3	1,250	7366084
	CA*F3743*6D*+TXV	A*EC961004CNA*	34,800	25,000	16.0	12.3	1,150	7366118
	CA*F3743*6D*+TXV	A*EC961205DNA*	34,800	25,000	15.5	12.3	1,250	7366123
	CA*F3743*6D*+TXV	A*VC81005C*B*	35,000	25,200	16.0	12.5	1,200	8005815
	CA*F3743*6D*+TXV	G*VC81005C*B*	35,000	25,200	16.0	12.5	1,200	8005816
	CA*F4860*6D*+TXV	A*VC80604B*B*	34,600	24,800	16.0	12.5	1,220	5039011
	CA*F4860*6D*+TXV	G*VC80604B*B*	34,600	24,800	16.0	12.5	1,220	5039221
	CA*F4860*6D*+TXV	A*VC80805C*B*	35,000	25,200	16.0	12.5	1,190	6497678
	CA*F4860*6D*+TXV	ADV80805C*B*	35,000	25,200	16.0	12.5	1,190	6497689
	CA*F4860*6D*+TXV	G*VC80805C*B*	35,000	25,200	16.0	12.5	1,190	6497690
	CA*F4961*6D*+TXV	G*VC960804CNA*	35,000	25,200	16.0	13.0	1,125	7356131
	CA*F4961*6D*+TXV	G*VC961205DNA*	35,000	25,200	16.0	13.0	1,115	7356141
	CA*F4961*6D*+TXV	G*VM970804CNA*	35,000	25,200	16.0	13.0	1,125	7356197
	CA*F4961*6D*+TXV	G*VM971005CNA*	35,000	25,200	16.0	13.0	1,200	7356202
	CA*F4961*6D*+TXV	G*VM971205DNA*	35,000	25,200	16.0	13.0	1,115	7356207
	CA*F4961*6D*+TXV	A*VC960804CNA*	35,000	25,200	16.0	13.0	1,125	7356273
	CA*F4961*6D*+TXV	A*VC961005CNA*	35,000	25,200	16.0	13.0	1,200	7356278
	CA*F4961*6D*+TXV	A*VC961205DNA*	35,000	25,200	16.0	13.0	1,115	7356283
	CA*F4961*6D*+TXV	A*VM970804CNA*	35,000	25,200	16.0	12.2	1,125	7356339
	CA*F4961*6D*+TXV	A*VM971005CNA*	35,000	25,200	16.0	13.0	1,200	7356344
	CA*F4961*6D*+TXV	A*VM971205DNA*	35,000	25,200	16.0	13.0	1,115	7356349
	CA*F4961*6D*+TXV	G*EC961004CNA*	35,000	25,200	16.0	12.5	1,150	7366080
	CA*F4961*6D*+TXV	G*EC961205DNA*	35,000	25,200	16.0	12.2	1,250	7366085
	CA*F4961*6D*+TXV	A*EC961004CNA*	35,000	25,200	16.0	12.5	1,150	7366119
	CA*F4961*6D*+TXV	A*EC961205DNA*	35,000	25,200	16.0	12.2	1,250	7366124
	CAPT3743*4A*	G*VC961205DNA*	34,200	24,600	15.5	12.2	1,115	7356142
	CAPT3743*4A*	G*VM971205DNA*	34,200	24,600	15.5	12.2	1,115	7356208
	CAPT3743*4A*	A*VM971205DNA*	34,200	24,600	15.5	12.2	1,115	7356350
	CAPT3743*4A*	A*EC961004CNA*	34,600	24,800	15.5	12.2	1,150	7366120
	CHPF3642C6C*+MBVC1600**-1A*+TXV		34,600	24,800	16.0	12.5	1,200	3654024
	CHPF3642C6C*+TXV	A*VC80805C*B*	34,600	24,800	16.0	12.5	1,190	6497691
	CHPF3642C6C*+TXV	G*VC80805C*B*	34,600	24,800	16.0	12.5	1,190	6497693
	CHPF3642D6C*+MBVC2000**-1A*+TXV		35,000	25,200	16.0	12.8	1,200	3654036
	CHPF3743C6B*+MBVC1600**-1A*+TXV		34,600	24,800	16.0	12.5	1,200	3654042
	CHPF3743C6B*+TXV	A*VC80805C*B*	34,600	24,800	16.0	12.5	1,190	6497702
	CHPF3743C6B*+TXV	G*VC80805C*B*	34,600	24,800	16.0	12.5	1,190	6497713
	CHPF3743C6B*+TXV	A*EC961004CNA*	34,600	24,800	15.5	12.2	1,150	7366121
CHPF3743D6B*+MBVC2000**-1A*+TXV		35,000	25,200	16.0	12.8	1,200	3654056	
CHPF3743D6B*+TXV	G*VC80604B*B*	34,000	24,400	16.0	12.5	1,220	5038828	
CHPF3743D6B*+TXV	A*VC80604B*B*	34,000	24,400	16.0	12.5	1,220	5039094	
CHPF3743D6B*+TXV	A*VC80805C*B*	34,000	24,400	16.0	12.5	1,190	6497714	
CHPF3743D6B*+TXV	G*VC80805C*B*	34,000	24,400	16.0	12.5	1,190	6497725	
CHPF3743D6B*+TXV	G*VC961205DNA*	34,200	24,600	15.5	12.2	1,115	7356143	
CHPF3743D6B*+TXV	G*VM971205DNA*	34,200	24,600	15.5	12.2	1,115	7356209	
CHPF3743D6B*+TXV	A*VC961205DNA*	34,200	24,600	15.5	12.2	1,115	7356285	
CHPF3743D6B*+TXV	A*VM971205DNA*	34,200	24,600	15.5	12.2	1,115	7356351	
CHPF3743D6B*+TXV	G*EC961205DNA*	34,600	24,800	15.5	12.2	1,250	7366087	

See Notes on Page 26.

OUTDOOR UNIT	INDOOR UNITS		COOLING RATINGS				CFM	AHRI #
	COILS/AIR HANDLERS	FURNACES	TOTAL ¹	SENS. ¹	SEER ²	EER ³		
DSXC16 0361A* (cont.)	CHPF3743D6B*+TXV	A*EC961205DNA*	34,600	24,800	15.5	12.2	1,250	7366126
	CHPF4860D6D*+TXV	G*VC80604B*B*	34,600	24,800	16.0	12.5	1,220	5038829
	CHPF4860D6D*+TXV	A*VC80604B*B*	34,600	24,800	16.0	12.5	1,220	5039095
	CHPF4860D6D*+TXV	A*VC80805C*B*	34,600	24,800	16.0	12.5	1,190	6497726
	CHPF4860D6D*+TXV	G*VC80805C*B*	34,600	24,800	16.0	12.5	1,190	6497737
	CHPF4860D6D*+TXV	G*VC961005CNA*	34,600	24,800	15.5	12.5	1,200	7356138
	CHPF4860D6D*+TXV	G*VC961205DNA*	34,200	24,600	15.5	12.5	1,115	7356144
	CHPF4860D6D*+TXV	G*VM971005CNA*	34,600	24,800	15.5	12.5	1,200	7356204
	CHPF4860D6D*+TXV	G*VM971205DNA*	34,200	24,600	15.5	12.5	1,115	7356210
	CHPF4860D6D*+TXV	A*VC961005CNA*	34,600	24,800	15.5	12.5	1,200	7356280
	CHPF4860D6D*+TXV	A*VC961205DNA*	34,200	24,600	15.5	12.5	1,115	7356286
	CHPF4860D6D*+TXV	A*VM971005CNA*	34,600	24,800	15.5	12.5	1,200	7356346
	CHPF4860D6D*+TXV	A*VM971205DNA*	34,200	24,600	15.5	12.5	1,115	7356352
	CSCF3642N6D*+TXV	A*VC960804CNA*	34,600	24,800	15.5	12.2	1,125	7356276
	CSCF3642N6D*+TXV	A*VM970804CNA*	34,600	24,800	15.5	12.2	1,125	7356342
	CSCF4860N6D*+TXV	G*VC961205DNA*	34,200	24,600	15.5	12.2	1,115	7356145
	CSCF4860N6D*+TXV	G*VM971205DNA*	34,200	24,600	15.5	12.2	1,115	7356211
	CSCF4860N6D*+TXV	A*VC961205DNA*	34,200	24,600	15.5	12.2	1,115	7356287
	CSCF4860N6D*+TXV	A*VM971205DNA*	34,200	24,600	15.5	12.2	1,115	7356353
	DV48PTCC14A*		34,400	24,800	15.0	12.2	1,100	7079239
DSXC16 0481B*	AVPTC48C14A*		45,500	34,200	14.5	11.7	1,450	7079240
	AVPTC48D14A*		46,000	34,600	15.5	12.0	1,575	5924365
	AVPTC60D14A*		45,500	34,200	16.0	12.0	1,430	6687799
	CA*F4860*6D*+EEP+TXV		47,000	35,200	14.5	12.0	1,675	5357203
	CA*F4860*6D*+MBVC1600**-1A*+TXV		46,000	34,600	15.0	12.0	1,600	6497743
	CA*F4860*6D*+MBVC2000**-1A*+TXV		47,000	35,200	16.0	12.5	1,600	4559576
	CA*F4860*6D*+TXV	A*VC81005C*B*	46,000	34,600	16.0	12.0	1,370	5038813
	CA*F4860*6D*+TXV	A*VC80805C*B*	46,000	34,600	16.0	12.3	1,390	5038832
	CA*F4860*6D*+TXV	G*VC80604B*B*	45,500	34,200	15.0	12.0	1,400	5039096
	CA*F4860*6D*+TXV	G*VC81005C*B*	46,000	34,600	16.0	12.0	1,370	5039097
	CA*F4860*6D*+TXV	ADVC80805C*B*	46,000	34,600	16.0	12.3	1,380	5039098
	CA*F4860*6D*+TXV	ADVC81005C*B*	46,000	34,600	16.0	12.0	1,410	5039099
	CA*F4860*6D*+TXV	A*VC80604B*B*	45,500	34,200	15.0	12.0	1,400	5039115
	CA*F4860*6D*+TXV	G*VC80805C*B*	46,000	34,600	16.0	12.3	1,390	5039223
	CA*F4860*6D*+TXV	G*VC960804CNA*	45,500	34,200	15.0	12.0	1,400	7356146
	CA*F4860*6D*+TXV	G*VC961005CNA*	45,500	34,200	15.0	12.0	1,400	7356151
	CA*F4860*6D*+TXV	G*VC961205DNA*	46,000	34,600	15.5	12.0	1,450	7356156
	CA*F4860*6D*+TXV	G*VM970804CNA*	45,500	34,200	15.0	12.0	1,400	7356212
	CA*F4860*6D*+TXV	G*VM971005CNA*	45,500	34,200	15.0	12.0	1,400	7356217
	CA*F4860*6D*+TXV	G*VM971205DNA*	46,000	34,600	15.5	12.0	1,450	7356222
	CA*F4860*6D*+TXV	A*VC960804CNA*	45,500	34,200	15.0	12.0	1,400	7356288
	CA*F4860*6D*+TXV	A*VC961005CNA*	45,500	34,200	15.0	12.0	1,400	7356293
	CA*F4860*6D*+TXV	A*VC961205DNA*	46,000	34,600	15.5	12.0	1,450	7356298
	CA*F4860*6D*+TXV	A*VM970804CNA*	45,500	34,200	15.0	12.0	1,400	7356354
	CA*F4860*6D*+TXV	A*VM971005CNA*	45,500	34,200	15.0	12.0	1,400	7356359
	CA*F4860*6D*+TXV	A*VM971205DNA*	46,000	34,600	15.5	12.0	1,450	7356364
	CA*F4961*6D*+EEP+TXV		48,000	36,000	14.5	12.0	1,675	5357204
	CA*F4961*6D*+MBVC1600**-1A*+TXV		46,000	34,600	15.0	12.0	1,400	4431661
	CA*F4961*6D*+MBVC2000**-1A*+TXV		47,000	35,200	16.0	12.5	1,400	4431662
	CA*F4961*6D*+TXV	ADVC80805C*B*	47,000	35,200	16.0	12.5	1,380	5038811
CA*F4961*6D*+TXV	A*VC80805C*B*	47,000	35,200	16.0	12.5	1,390	5038814	
CA*F4961*6D*+TXV	G*VC80805C*B*	47,000	35,200	16.0	12.5	1,390	5038933	

See Notes on Page 26.

OUTDOOR UNIT	INDOOR UNITS		COOLING RATINGS				CFM	AHRI #	
	COILS/AIR HANDLERS	FURNACES	TOTAL ¹	SENS. ¹	SEER ²	EER ³			
DSXC16 0481B* (cont.)	CA*F4961*6D*+TXV	ADVC81005C*B*	46,500	35,000	16.0	12.0	1,410	5038936	
	CA*F4961*6D*+TXV	G*VC81005C*B*	46,500	35,000	16.0	12.0	1,370	5039012	
	CA*F4961*6D*+TXV	G*VC80604B*B*	46,000	34,600	16.0	12.3	1,400	5039100	
	CA*F4961*6D*+TXV	A*VC80604B*B*	46,000	34,600	16.0	12.3	1,400	5039101	
	CA*F4961*6D*+TXV	A*VC81005C*B*	46,500	35,000	16.0	12.0	1,370	5039225	
	CA*F4961*6D*+TXV	G*VC960804CNA*	46,500	35,000	15.5	12.0	1,400	7356147	
	CA*F4961*6D*+TXV	G*VC961005CNA*	46,500	35,000	15.5	12.0	1,400	7356152	
	CA*F4961*6D*+TXV	G*VC961205DNA*	47,000	35,200	16.0	12.0	1,450	7356157	
	CA*F4961*6D*+TXV	G*VM970804CNA*	46,500	35,000	15.5	12.0	1,400	7356213	
	CA*F4961*6D*+TXV	G*VM971005CNA*	46,500	35,000	15.5	12.0	1,400	7356218	
	CA*F4961*6D*+TXV	G*VM971205DNA*	47,000	35,200	16.0	12.0	1,450	7356223	
	CA*F4961*6D*+TXV	A*VC960804CNA*	46,500	35,000	15.5	12.0	1,400	7356289	
	CA*F4961*6D*+TXV	A*VC961005CNA*	46,500	35,000	15.5	12.0	1,400	7356294	
	CA*F4961*6D*+TXV	A*VC961205DNA*	47,000	35,200	16.0	12.0	1,450	7356299	
	CA*F4961*6D*+TXV	A*VM970804CNA*	46,500	35,000	15.5	12.0	1,400	7356355	
	CA*F4961*6D*+TXV	A*VM971005CNA*	46,500	35,000	15.5	12.0	1,400	7356360	
	CA*F4961*6D*+TXV	A*VM971205DNA*	47,000	35,200	16.0	12.0	1,450	7356365	
	CA*F4961*6D*+TXV	G*EC961004CNA*	46,500	35,000	15.5	12.0	1,550	7366088	
	CA*F4961*6D*+TXV	G*EC961205DNA*	46,500	35,000	15.5	12.0	1,520	7366091	
	CA*F4961*6D*+TXV	A*EC961004CNA*	46,500	35,000	15.5	12.0	1,550	7366127	
	CA*F4961*6D*+TXV	A*EC961205DNA*	46,500	35,000	15.5	12.0	1,520	7366130	
	CAPT4961*4A*	G*VC960804CNA*	46,500	35,000	15.0	12.0	1,400	7356148	
	CAPT4961*4A*	G*VC961005CNA*	46,500	35,000	15.0	12.0	1,400	7356153	
	CAPT4961*4A*	G*VC961205DNA*	47,000	35,200	15.5	12.0	1,450	7356158	
	CAPT4961*4A*	G*VM970804CNA*	46,500	35,000	15.0	12.0	1,400	7356214	
	CAPT4961*4A*	G*VM971005CNA*	46,500	35,000	15.0	12.0	1,400	7356219	
	CAPT4961*4A*	G*VM971205DNA*	47,000	35,200	15.5	12.0	1,450	7356224	
	CAPT4961*4A*	A*VC960804CNA*	46,500	35,000	15.0	12.0	1,400	7356290	
	CAPT4961*4A*	A*VC961005CNA*	46,500	35,000	15.0	12.0	1,400	7356295	
	CAPT4961*4A*	A*VC961205DNA*	47,000	35,200	15.5	12.0	1,450	7356300	
	CAPT4961*4A*	A*VM970804CNA*	46,500	35,000	15.0	12.0	1,400	7356356	
	CAPT4961*4A*	A*VM971005CNA*	46,500	35,000	15.0	12.0	1,400	7356361	
	CAPT4961*4A*	A*VM971205DNA*	47,000	35,200	15.5	12.0	1,450	7356366	
	CAPT4961*4A*	G*EC961004CNA*	46,500	35,000	15.0	12.0	1,550	7366089	
	CAPT4961*4A*	G*EC961205DNA*	46,500	35,000	15.0	12.0	1,520	7366092	
	CAPT4961*4A*	A*EC961004CNA*	46,500	35,000	15.0	12.0	1,550	7366128	
	CAPT4961*4A*	A*EC961205DNA*	46,500	35,000	15.0	12.0	1,520	7366131	
	CHPF4860D6D*+EEP+TXV			48,000	36,000	14.5	12.0	1,675	5357205
	CHPF4860D6D*+MBVC1600**-1A*+TXV			46,000	34,600	15.0	12.0	1,400	4172507
	CHPF4860D6D*+MBVC2000**-1A*+TXV			47,000	35,200	16.0	12.5	1,400	4172508
	CHPF4860D6D*+TXV	G*VC80604B*B*		45,500	34,200	15.5	12.0	1,400	5038812
	CHPF4860D6D*+TXV	G*VC81005C*B*		45,500	34,200	15.5	12.0	1,370	5038830
	CHPF4860D6D*+TXV	A*VC80805C*B*		45,500	34,200	15.5	12.0	1,390	5038833
	CHPF4860D6D*+TXV	A*VC80604B*B*		45,500	34,200	15.5	12.0	1,400	5039102
	CHPF4860D6D*+TXV	G*VC80805C*B*		45,500	34,200	15.5	12.0	1,390	5039224
	CHPF4860D6D*+TXV	A*VC81005C*B*		45,500	34,200	15.5	12.0	1,370	5039226
	CHPF4860D6D*+TXV	G*VC960804CNA*		46,000	34,600	15.5	12.0	1,400	7356149
	CHPF4860D6D*+TXV	G*VC961005CNA*		46,000	34,600	15.5	12.0	1,400	7356154
CHPF4860D6D*+TXV	G*VC961205DNA*		47,000	35,200	15.5	12.0	1,450	7356159	
CHPF4860D6D*+TXV	G*VM970804CNA*		46,000	34,600	15.5	12.0	1,400	7356215	
CHPF4860D6D*+TXV	G*VM971005CNA*		46,000	34,600	15.5	12.0	1,400	7356220	
CHPF4860D6D*+TXV	G*VM971205DNA*		47,000	35,200	15.5	12.0	1,450	7356225	

See Notes on Page 26.

OUTDOOR UNIT	INDOOR UNITS		COOLING RATINGS				CFM	AHRI #
	COILS/AIR HANDLERS	FURNACES	TOTAL ¹	SENS. ¹	SEER ²	EER ³		
DSXC16 0481B* (cont.)	CHPF4860D6D*+TXV	A*VC960804CNA*	46,000	34,600	15.5	12.0	1,400	7356291
	CHPF4860D6D*+TXV	A*VC961005CNA*	46,000	34,600	15.5	12.0	1,400	7356296
	CHPF4860D6D*+TXV	A*VC961205DNA*	47,000	35,200	15.5	12.0	1,450	7356301
	CHPF4860D6D*+TXV	A*VM970804CNA*	46,000	34,600	15.5	12.0	1,400	7356357
	CHPF4860D6D*+TXV	A*VM971005CNA*	46,000	34,600	15.5	12.0	1,400	7356362
	CHPF4860D6D*+TXV	A*VM971205DNA*	47,000	35,200	15.5	12.0	1,450	7356367
	CHPF4860D6D*+TXV	G*EC961004CNA*	46,000	34,600	15.5	12.0	1,550	7366090
	CHPF4860D6D*+TXV	G*EC961205DNA*	46,000	34,600	15.5	12.0	1,520	7366093
	CHPF4860D6D*+TXV	A*EC961004CNA*	46,000	34,600	15.5	12.0	1,550	7366129
	CHPF4860D6D*+TXV	A*EC961205DNA*	46,000	34,600	15.5	12.0	1,520	7366132
	CSCF4860N6D*+EEP+TXV		48,000	36,000	14.5	12.0	1,675	5357206
	CSCF4860N6D*+TXV	G*VC960804CNA*	45,500	34,200	15.0	12.0	1,400	7356150
	CSCF4860N6D*+TXV	G*VC961005CNA*	45,500	34,200	15.0	12.0	1,400	7356155
	CSCF4860N6D*+TXV	G*VC961205DNA*	46,000	34,600	15.5	12.0	1,450	7356160
	CSCF4860N6D*+TXV	G*VM970804CNA*	45,500	34,200	15.0	12.0	1,400	7356216
	CSCF4860N6D*+TXV	G*VM971005CNA*	45,500	34,200	15.0	12.0	1,400	7356221
	CSCF4860N6D*+TXV	G*VM971205DNA*	46,000	34,600	15.5	12.0	1,450	7356226
	CSCF4860N6D*+TXV	A*VC960804CNA*	45,500	34,200	15.0	12.0	1,400	7356292
	CSCF4860N6D*+TXV	A*VC961005CNA*	45,500	34,200	15.0	12.0	1,400	7356297
	CSCF4860N6D*+TXV	A*VC961205DNA*	46,000	34,600	15.5	12.0	1,450	7356302
CSCF4860N6D*+TXV	A*VM970804CNA*	45,500	34,200	15.0	12.0	1,400	7356358	
CSCF4860N6D*+TXV	A*VM971005CNA*	45,500	34,200	15.0	12.0	1,400	7356363	
CSCF4860N6D*+TXV	A*VM971205DNA*	46,000	34,600	15.5	12.0	1,450	7356368	
DV48PTCC14A*		45,500	34,200	14.5	11.7	1,450	7079241	
DSXC16 0601B*	AVPTC60D14A*		57,000	42,500	15.5	12.0	1,780	5924366
	CA*F4860*6D*+MBVC2000**-1A*+TXV		55,500	41,000	15.5	12.0	1,800	3880338
	CA*F4860*6D*+TXV	ADVC81005C*B*	55,500	41,000	15.5	12.0	1,550	5038834
	CA*F4860*6D*+TXV	A*VC80805C*B*	55,500	41,000	15.5	12.0	1,590	5038937
	CA*F4860*6D*+TXV	A*VC81005C*B*	55,500	41,000	15.5	12.0	1,610	5038965
	CA*F4860*6D*+TXV	G*VC80805C*B*	55,500	41,000	15.5	12.0	1,590	5039104
	CA*F4860*6D*+TXV	ADVC80805C*B*	55,500	41,000	15.5	12.0	1,580	5039105
	CA*F4860*6D*+TXV	G*VC81005C*B*	55,500	41,000	15.5	12.0	1,610	5039227
	CA*F4860*6D*+TXV	G*VC961205DNA*	55,000	41,000	15.5	12.0	1,600	7356171
	CA*F4860*6D*+TXV	G*VM970804CNA*	55,000	41,000	15.0	11.7	1,550	7356227
	CA*F4860*6D*+TXV	G*VM971005CNA*	55,000	41,000	15.0	11.7	1,600	7356232
	CA*F4860*6D*+TXV	G*VM971205DNA*	55,000	41,000	15.5	12.0	1,600	7356237
	CA*F4860*6D*+TXV	A*VC961205DNA*	55,000	41,000	15.5	12.0	1,600	7356313
	CA*F4860*6D*+TXV	A*VM971205DNA*	55,000	41,000	15.5	12.0	1,600	7356379
	CA*F4961*6D*+EEP+TXV		56,000	41,500	14.0	11.8	1,550	5357207
	CA*F4961*6D*+MBVC2000**-1A*+TXV		57,000	42,500	16.0	12.3	1,800	4431664
	CA*F4961*6D*+TXV	G*VC80805C*B*	56,000	41,500	15.5	12.3	1,590	5038815
	CA*F4961*6D*+TXV	A*VC81005C*B*	56,000	41,500	15.5	12.0	1,610	5038835
	CA*F4961*6D*+TXV	G*VC81005C*B*	56,000	41,500	15.5	12.0	1,610	5038964
	CA*F4961*6D*+TXV	A*VC80805C*B*	56,000	41,500	15.5	12.3	1,590	5038966
	CA*F4961*6D*+TXV	ADVC81005C*B*	56,000	41,500	15.5	12.0	1,550	5039013
	CA*F4961*6D*+TXV	ADVC80805C*B*	56,000	41,500	15.5	12.3	1,580	5039116
	CA*F4961*6D*+TXV	G*VC960804CNA*	55,000	41,000	15.5	11.7	1,550	7356162
	CA*F4961*6D*+TXV	G*VC961005CNA*	55,000	41,000	15.5	11.7	1,600	7356167
CA*F4961*6D*+TXV	G*VC961205DNA*	55,000	41,000	15.5	12.0	1,600	7356172	
CA*F4961*6D*+TXV	G*VM970804CNA*	55,000	41,000	15.5	11.7	1,550	7356228	
CA*F4961*6D*+TXV	G*VM971005CNA*	55,000	41,000	15.5	11.7	1,600	7356233	
CA*F4961*6D*+TXV	G*VM971205DNA*	55,000	41,000	15.5	12.0	1,600	7356238	

See Notes on Page 26.

OUTDOOR UNIT	INDOOR UNITS		COOLING RATINGS				CFM	AHRI #
	COILS/AIR HANDLERS	FURNACES	TOTAL ¹	SENS. ¹	SEER ²	EER ³		
DSXC16 0601B* (cont.)	CA*F4961*6D*+TXV	A*VC960804CNA*	55,000	41,000	15.5	11.7	1,550	7356304
	CA*F4961*6D*+TXV	A*VC961005CNA*	55,000	41,000	15.5	11.7	1,600	7356309
	CA*F4961*6D*+TXV	A*VC961205DNA*	55,000	41,000	15.5	12.0	1,600	7356314
	CA*F4961*6D*+TXV	A*VM970804CNA*	55,000	41,000	15.5	11.7	1,550	7356370
	CA*F4961*6D*+TXV	A*VM971005CNA*	55,000	41,000	15.5	11.7	1,600	7356375
	CA*F4961*6D*+TXV	A*VM971205DNA*	55,000	41,000	15.5	12.0	1,600	7356380
	CA*F4961*6D*+TXV	G*EC961205DNA*	56,000	41,500	15.5	11.7	1,520	7366094
	CA*F4961*6D*+TXV	A*EC961205DNA*	56,000	41,500	15.5	11.7	1,520	7366133
	CAPT4961*4A*	G*VC961205DNA*	55,000	41,000	15.0	12.0	1,600	7356173
	CAPT4961*4A*	G*VM970804CNA*	55,000	41,000	15.0	11.7	1,550	7356229
	CAPT4961*4A*	G*VM971005CNA*	55,000	41,000	15.0	11.7	1,600	7356234
	CAPT4961*4A*	G*VM971205DNA*	55,000	41,000	15.0	12.0	1,600	7356239
	CAPT4961*4A*	A*VC961205DNA*	55,000	41,000	15.0	12.0	1,600	7356315
	CAPT4961*4A*	A*VM971205DNA*	55,000	41,000	15.0	12.0	1,600	7356381
	CAPT4961*4A*	G*EC961205DNA*	56,000	41,500	15.0	11.7	1,520	7366095
	CHPF4860D6D*+EEP+TXV		56,000	41,500	14.0	11.8	1,550	5357208
	CHPF4860D6D*+MBVC2000**-1A*+TXV		57,000	42,500	15.5	12.3	1,800	3798903
	CHPF4860D6D*+TXV	A*VC81005C*B*	56,000	41,500	15.5	12.0	1,610	5038967
	CHPF4860D6D*+TXV	G*VC80805C*B*	56,000	41,500	15.5	12.3	1,590	5039014
	CHPF4860D6D*+TXV	A*VC80805C*B*	56,000	41,500	15.5	12.3	1,590	5039106
	CHPF4860D6D*+TXV	G*VC81005C*B*	56,000	41,500	15.5	12.0	1,610	5039117
	CHPF4860D6D*+TXV	G*VC960804CNA*	55,000	41,000	15.5	11.7	1,550	7356164
	CHPF4860D6D*+TXV	G*VC961205DNA*	55,000	41,000	15.5	12.0	1,600	7356174
	CHPF4860D6D*+TXV	G*VM970804CNA*	55,000	41,000	15.5	11.7	1,550	7356230
	CHPF4860D6D*+TXV	G*VM971005CNA*	55,000	41,000	15.5	11.7	1,600	7356235
	CHPF4860D6D*+TXV	G*VM971205DNA*	55,000	41,000	15.5	12.0	1,600	7356240
	CHPF4860D6D*+TXV	A*VC960804CNA*	55,000	41,000	15.5	11.7	1,550	7356306
	CHPF4860D6D*+TXV	A*VC961005CNA*	55,000	41,000	15.5	11.7	1,600	7356311
	CHPF4860D6D*+TXV	A*VC961205DNA*	55,000	41,000	15.5	12.0	1,600	7356316
	CHPF4860D6D*+TXV	A*VM970804CNA*	55,000	41,000	15.5	11.7	1,550	7356372
	CHPF4860D6D*+TXV	A*VM971005CNA*	55,000	41,000	15.5	11.7	1,600	7356377
	CHPF4860D6D*+TXV	A*VM971205DNA*	55,000	41,000	15.5	12.0	1,600	7356382
	CHPF4860D6D*+TXV	G*EC961205DNA*	56,000	41,500	15.5	11.7	1,520	7366096
	CHPF4860D6D*+TXV	A*EC961205DNA*	56,000	41,500	15.5	11.7	1,520	7366135
	CSCF4860N6D*+EEP+TXV		56,000	41,500	14.0	11.8	1,550	5357209
	CSCF4860N6D*+TXV	G*VC960804CNA*	55,000	41,000	15.0	11.7	1,550	7356165
	CSCF4860N6D*+TXV	G*VC961205DNA*	55,000	41,000	15.0	12.0	1,600	7356175
	CSCF4860N6D*+TXV	G*VM970804CNA*	55,000	41,000	15.0	11.7	1,550	7356231
	CSCF4860N6D*+TXV	G*VM971005CNA*	55,000	41,000	15.0	11.7	1,600	7356236
	CSCF4860N6D*+TXV	G*VM971205DNA*	55,000	41,000	15.0	12.0	1,600	7356241
CSCF4860N6D*+TXV	A*VC960804CNA*	55,000	41,000	15.0	11.7	1,550	7356307	
CSCF4860N6D*+TXV	A*VC961005CNA*	55,000	41,000	15.0	11.7	1,600	7356312	
CSCF4860N6D*+TXV	A*VC961205DNA*	55,000	41,000	15.0	12.0	1,600	7356317	
CSCF4860N6D*+TXV	A*VM970804CNA*	55,000	41,000	15.0	11.7	1,550	7356373	
CSCF4860N6D*+TXV	A*VM971005CNA*	55,000	41,000	15.0	11.7	1,600	7356378	
CSCF4860N6D*+TXV	A*VM971205DNA*	55,000	41,000	15.0	12.0	1,600	7356383	


¹ BTU/h

² Seasonal Energy Efficiency Ratio; Certified per AHRI 210/240 @ 80°F/ 67°F/ 95°F


³ Energy Efficiency Ratio @ 80°F/ 67°F/ 95°F

NOTES

- Always check the S&R plate for electrical data on the unit being installed.
- When matching the outdoor unit to the indoor unit, use the piston supplied with the outdoor unit or that specified on the piston kit chart supplied with the indoor unit.
- EEP - Order from Service Dept. Part No. B13707-38 or new Solid State Board B13707-35S. Part No. B13707-38 is not interchangeable with B13707-35S. The Goodman Gas Furnace contains the EEP cooling time delay

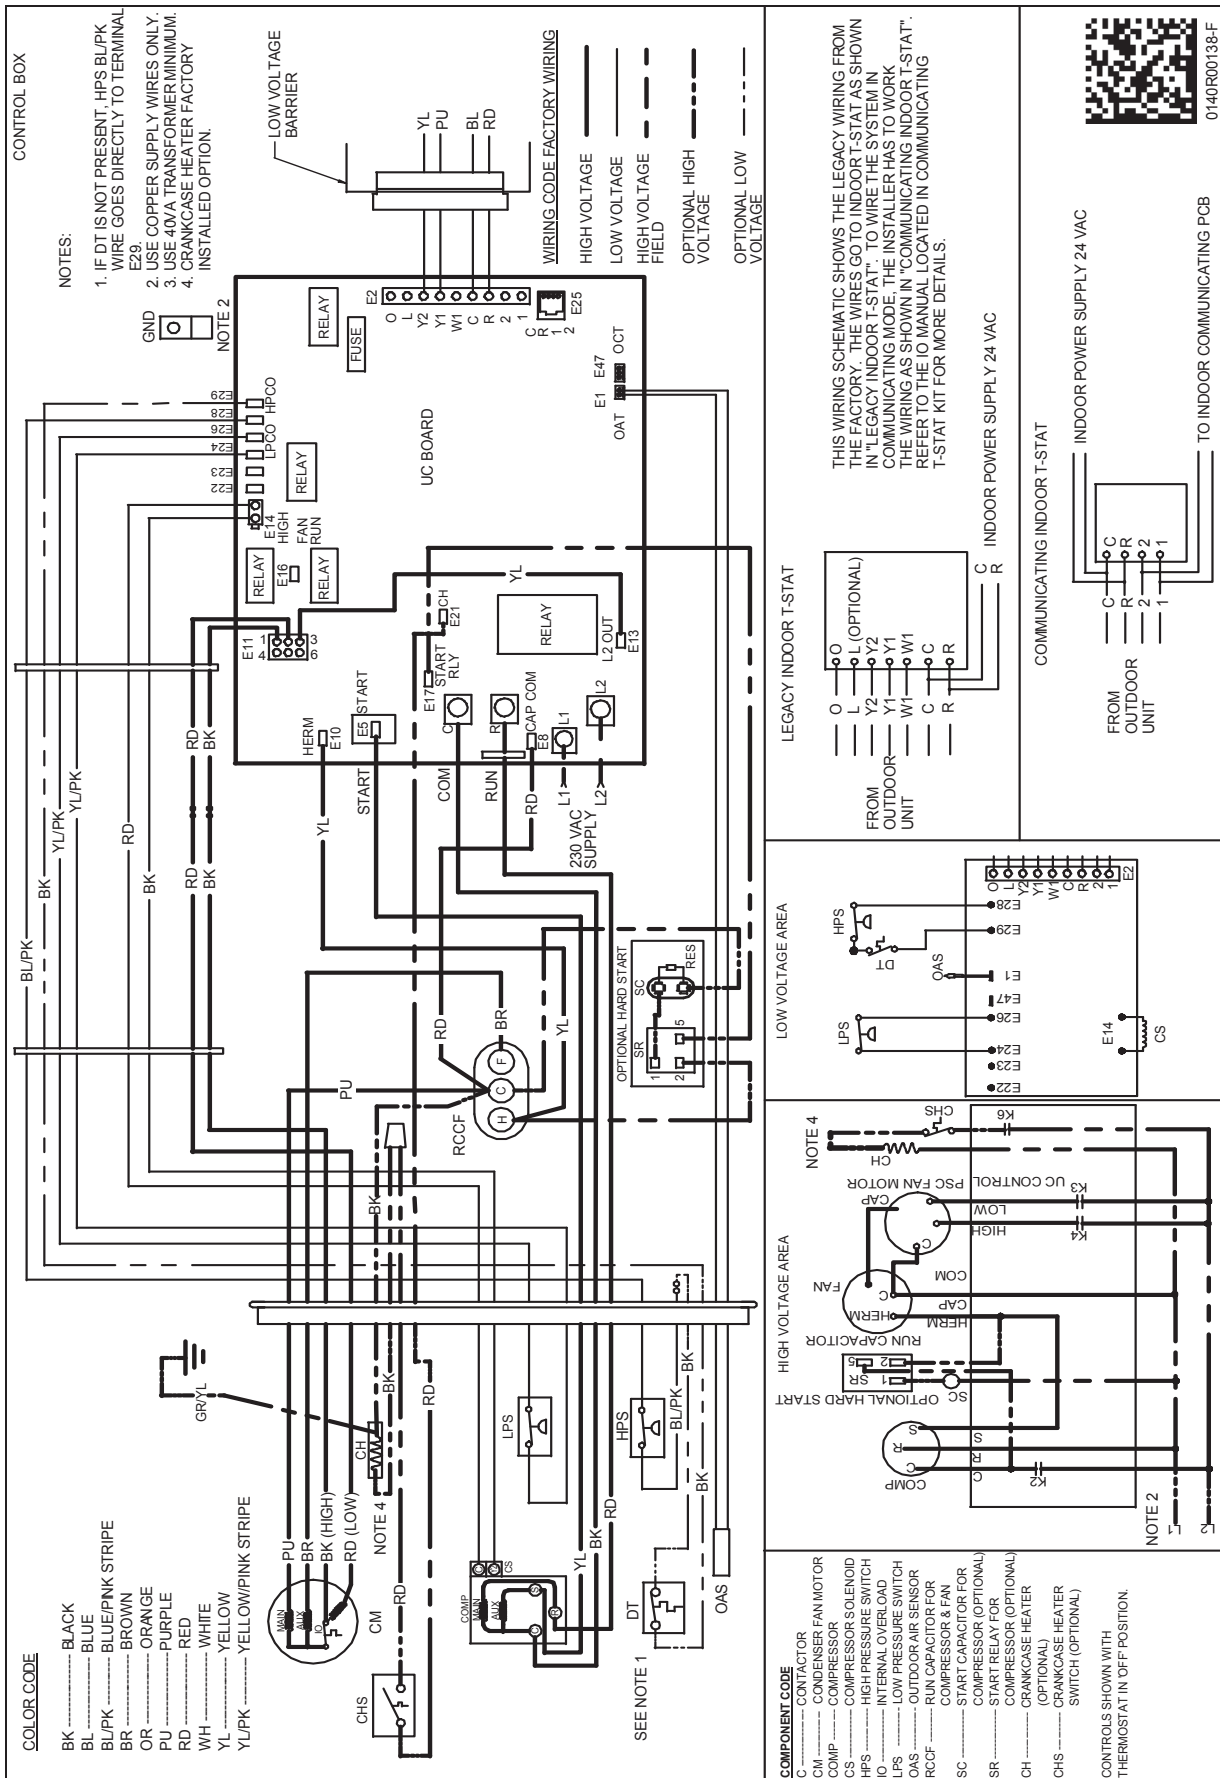

DIMENSIONS

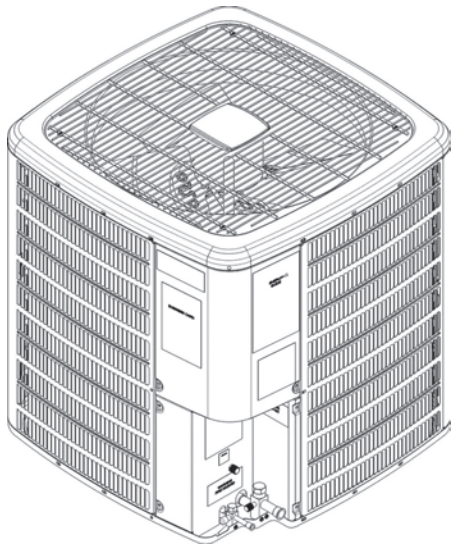

MODEL	DIMENSIONS		
	W"	D"	H"
DSXC160241A*	29	29	32½
DSXC160361A*	29	29	38½
DSXC160481B*	35½	35½	36½
DSXC160601B*	35½	35½	38½

ACCESSORIES

MODEL	DESCRIPTION	DSXC16 024**	DSXC16 036**	DSXC16 048**	DSXC16 060**
ABK-20	Anchor Bracket Kit [^]	X	X	X	X
ASC-01	Anti-Short Cycle Kit	X	X	X	X
B1141643 ¹	24V Transformer	X	X	X	X
CSR-U-1	Hard-start Kit	X	X	X	
CSR-U-2	Hard-start Kit		X		
CSR-U-3	Hard-start Kit				X
FSK01A ²	Freeze Protection Kit	X	X	X	X
LSK02A	Liquid Line Solenoid Valve	X	X	X	X
OT18-60A ³	Outdoor Thermostat/Lockout Thermostat	X	X	X	X
TX2N4	TXV Kit	X			
TX2N4A	TXV Kit	X			
TX3N4 ⁴	TXV Kit		X		
TX5N4	TXV Kit			X	X

[^] Contains 20 brackets; four brackets needed to anchor unit to pad

¹ This component is included in the CTK01AA communicating thermostat kit.

² Installed on indoor coil

³ Available in 24V legacy mode only. This feature is integrated in the communicating mode.

Note: Maximum number of installed accessories at the same time is limited by the size of the unit's control box.